

Semi-Annual Environmental Monitoring Report

Project number: 42173-013

Period: January – June 2020
Submission Date: November 2020

BAN: Dhaka Environmentally Sustainable Water Supply Project – PART E

This report was prepared by Dhaka Water Supply and Sewerage Authority, Ministry of Local Government and Rural Development and Cooperatives, Government of Bangladesh for the Asian Development Bank. This document is made publicly available in accordance with ADB's Access to Information Policy and does not necessarily reflect the views of ADB.

This environmental monitoring report is a document of the borrower. The views expressed herein do not necessarily represent those of ADB's Board of Directors, Management, or staff, and may be preliminary in nature. Your attention is directed to the "terms of use" section of this website.

In preparing any country program or strategy, financing any project, or by making any designation of or reference to a particular territory or geographic area in this document, the Asian Development Bank does not intend to make any judgments as to the legal or other status of any territory or area.

ENVIRONMENTAL STATUS NOISE MONITORING




I. Water Quality

DHAKA WATER SUPPLY AND SEWERAGE AUTHORITY (DWASA)



DHAKA ENVIRONMENTALLY SUSTAINABLE WATER SUPPLY PROJECT (DESWSP)

SURFACE WATER QUALITY MONITORING (4th PHASE) PROPOSED INTAKE POINT AT
BISHNONDI, BANK OF MEGHNA RIVER, ARIHAZAR UNDER DESWSP, DWASA.

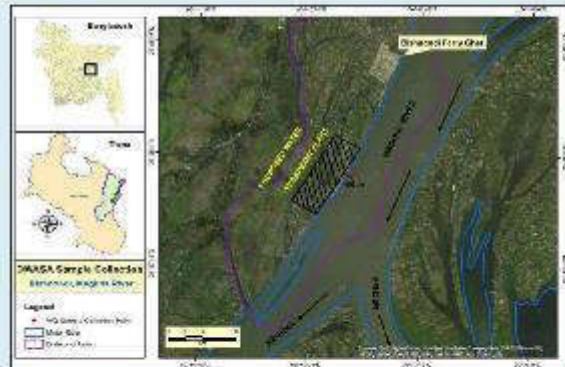

MONTHLY REPORT

JANUARY/2020

Submitted By



ONUSHANDHANI CREEDS LIMITED (O.CREEDS)

House: 135, Floor: 2nd, Road: 05, Mohakhali DOHS, Dhaka-1206

Contact: 8801712955908

E-mail: ceo@ocreeds.com & ocreedsbd@gmail.com

www.ocreeds.com



EXECUTIVE SUMMARY

To assess the variation of surface water quality over the period of eighteen months for better understanding of appropriate surface water treatment facilities for the proposed 500MLD DWASA surface treatment plant which is going to install at Bishnondi Araihaazar using Meghna river water for ensuring better quality water supply at mega-city Dhaka.

Targeting the above work, ONUSHANDHANI CREEDS LIMITED, a well reputed consulting firm, has been assigned to conduct surface water quality monitoring at proposed intake point at Bishnondi, Bank of Meghna, Araihaazar under DESWSP, DWASA [RIQW-3.32] for eighteen months.

This report is one of a series of monthly reports on the Surface Water Quality Monitoring (4th Phase) At Proposed Raw Water Intake Point at Bishnondi, Bank of Meghna, Araihaazar Under Dhaka Environmentally Sustainable Water Supply Project (DESWSP), DWASA. The report summarizes the results of the surface water quality monitoring for the month of January/2020 including December, November, October, September, August and July of 2019.

Measurement of physicochemical parameters are Temperature; pH; Salinity; Conductivity; Turbidity; Dissolved Oxygen (DO); Total Dissolved Solid (TDS); Ammonia (NH_3); Total Hardness and color at field during weekly sampling.

During monthly sampling, composite sample were sent to DPHE Central laboratory for the analysis of a wide range of water quality parameter and parameters are Nitrate; Nitrite; COD; TSS; BOD₅; Phosphate; Alkalinity; Ammonia; Total Hardness; Arsenic; Iron; Manganese and Aluminum and field parameter were tested as same as weekly sample parameters.

During the eighteen months study period, five times seasonal sample need to be collected which is hourly basis and sampling duration is 13 hours during daylight time and composite sample were send to DPHE Central laboratory and BCSIR Laboratory for the analysis of a wide range of water quality parameter and parameters are Arsenic; Algae; Barium; Cadmium; Chloride; Chromium(Hexavalent); Coliform(fecal); BOD; COD; Lead; Mercury; Ammonia; Nitrate; Nitrite; Phosphate; TOC; Pesticides (Organo-chlorine); Pesticides (Organo-phosphorus); Oil & Grease; Fluoride; Selenium; Zinc; Sulphate; Copper; Antimony; Boron; Nickel and Sodium. Field parameter were tested as same as weekly sample parameters.

BOD and COD values were found to be 2 mg/L and 4mg/L respectively during monthly sample analysis which is approximately constant with the preceding month for BOD and COD value dropped. To understand the pollution, trend more data from different months are required.

Ammonia concentration of most samples are above the safe limit as per Bangladesh Drinking Water Quality Standard. (NH_3 0.5mg/L). The concentration of ammonia has increased in the month of December and then decreased in January. However, tendency of ammonia concentration to increase with respect to time has been found in the last four months. In conjunction, increasing of dissolved oxygen (DO), pH value, reduction of turbidity and color unit were found for December.

Water Quality Index has also been calculated for weekly and monthly samples.



TABLE OF CONTENTS

EXECUTIVE SUMMARY	i
LIST OF FIGURES	ii
LIST OF TABLES	iii
ACRONYMS AND ABBREVIATIONS.....	iv
1 INTRODUCTION.....	5
1.1 BACKGROUND.....	5
1.2 OBJECTIVES.....	7
1.3 SCOPE OF WORKS.....	7
1.4 DESCRIPTION OF SAMPLING AREA.....	7
1.5 Work Plan and Professional Staffing.....	9
2 METHODOLOGY	11
2.1 Sampling Approach and Methodology.....	11
2.2 Duration of the monitoring.....	12
3 DESCRIPTION OF SAMPLING	13
3.1 Sampling Schedule:	13
3.2 Field Visits.....	15
3.3 Laboratory Tests.....	16
3.4 List of portable instrument/ Test kit and others use during field activities:	19
3.5 Field Survey data form:	19
3.6 Drinking Water Quality Standard:.....	19
4 RESULTS AND DISCUSSIONS	20
4.1 Weekly sampling- Field test results.....	20
4.2 Laboratory Test Results- Monthly Sample	24
5 CONCLUSION.....	25
ANNEXURES.....	27



LIST OF FIGURES

Figure 1:1 Schematic diagram- Different source for Surface water pollution	5
Figure 1:2 Schematic diagram-River pollution around Dhaka City	6
Figure 1:3 Study Area Map of Bishnondi, Araihasar	7
Figure 1:4 Sample collections point of Bishnondi, Araihasar	8
Figure 1:5 Work Plan of the Project	9
Figure 3:1 Central Laboratory, DPHE, Mohakhali, Dhaka	18
Figure 3:2 Bangladesh Council for Scientific and Industrial Research (BCSIR)	18
Figure 4:1 Comparison of different water quality parameters at different depth; 1 st week	20
Figure 4:2 Comparison of different water quality parameters at different depth; 2 nd week	21
Figure 4:3 Comparison of different water quality parameters at different depth; 3 rd week	22
Figure 4:4 Comparison of different water quality parameters at different depth; 4 th week	23
Figure A.1 Weekly Sampling Results; 18/07/2019	44
Figure A.2 Weekly sampling results; 25/07/2019	45
Figure A.3 Weekly sampling results; 31/07/2019	46
Figure A.4 Weekly sampling results; 01/08/2019	47
Figure A.5 Weekly sampling results; 08/08/2019	48
Figure A.6 Weekly sampling results; 14/08/2019	49
Figure A.7 Weekly sampling results; 21/08/2019	50
Figure A.8 Weekly sampling results; 05/09/2019	53
Figure A.9 Weekly sampling results; 14/09/2019	54
Figure A.10 Weekly sampling results; 21/09/2019	55
Figure A.11 Weekly sampling results; 28/09/2019	56
Figure A.12 Weekly sampling results; 05/10/2019	57
Figure A.13 Weekly sampling results; 12/10/2019	58
Figure A.14 Weekly sampling results; 19/10/2019	59
Figure A.15 Weekly sampling results; 26/10/2019	60
Figure A.16 Weekly sampling results; 02/11/2019	61
Figure A.17 Weekly sampling results; 11/11/2019	62
Figure A.18 Weekly sampling results; 16/11/2019	63
Figure A.19 Weekly sampling results; 23/11/2019	64
Figure A.20 Weekly sampling results; 30/11/2019	65
Figure A.21 Weekly sampling results; 07/12/2019	66
Figure A.22 Weekly sampling results; 14/12/2019	67
Figure A.23 Weekly sampling results; 21/12/2019	68
Figure A.24 Seasonal sampling results; 1 st grab sample 28/12/2019	69
Figure A.25 Seasonal sampling results; 2 nd grab sample 28/12/2019	70
Figure A.26 Seasonal sampling results; 3 rd grab sample 28/12/2019	71
Figure A.27 Seasonal sampling results; composite sample 28/12/2019	72



LIST OF TABLES

Table 1-1: List of Professional staff involved in this study.....	10
Table 3-1: Field test parameters.....	13
Table 3-2: Hourly Sampling parameters.....	14
Table 3-3: Field Visit Schedule.....	15
Table 3-4: Laboratory test parameters for monthly sample.....	16
Table 3-5: Laboratory test parameters for hourly sample.....	16
Table 3-6: Laboratory test equipment used for test.....	17
Table 4-1: Weekly Sampling Field Test Results: Sampling date: 04-01-2020.....	20
Table 4-2: Weekly Sampling Field Test Results: Sampling date: 11/01/2020.....	21
Table 4-3: Weekly Sampling Field Test Results: Sampling date: 18/01/2020.....	22
Table W-1: Weekly Sampling Results; 18/07/2019.....	44
Table W-2: Weekly sampling results; 25/07/2019.....	45
Table W-3: Weekly sampling results; Month: 31/July/2019.....	46
Table W-4: Weekly sampling results; Month: 1/August/2019.....	47
Table W-5: Weekly sampling results; Month: 8/August/2019.....	48
Table W-6: Weekly sampling results; Month: 14/August/2019.....	49
Table W-7: Weekly sampling results; Month: 21/August/2019.....	50
Table W-8: Weekly sampling results; Month: 5/September/2019.....	53
Table W-9: Weekly sampling results; Month: 14/September/2019.....	54
Table W-10: Weekly sampling results; Month: 21/September/2019.....	55
Table W-11: Weekly sampling results; Month: 28/September/2019.....	56
Table W-12: Weekly sampling results; Month: 12/October/2019.....	57
Table W-13: Weekly sampling results; Month: 12/October/2019.....	58
Table W-14: Weekly sampling results; Month: 19/October/2019.....	59
Table W-15: Weekly sampling results; Month: 26/October/2019.....	60
Table W-16: Weekly sampling results; Month: 02/November/2019.....	61
Table W-17: Weekly sampling results; Month: 11/November/2019.....	62
Table W-18: Weekly sampling results; Month: 16/November/2019.....	63
Table W-19: Weekly sampling results; Month: 23/November/2019.....	64
Table W-20: Weekly sampling results; Month: 30/November/2019.....	65
Table W-21: Weekly sampling results; Month: 07/December/2019.....	66
Table W-22: Weekly sampling results; Month: 14/December/2019.....	67
Table W-23: Weekly sampling results; Month: 21/December/2019.....	68
Table W-24: Seasonal sampling results; 1 st grab sample 28/12/2019.....	69
Table W-25: Seasonal sampling results; 2 nd grab sample 28/12/2019.....	70
Table W-26: Seasonal sampling results; 3 rd grab sample 28/12/2019.....	71
Table W-27: Seasonal sampling results; composite sample 28/12/2019.....	72



ACRONYMS AND ABBREVIATIONS

AOI	Area of Interest
BMD	Bangladesh Meteorological Department
BWDB	Bangladesh Water Development Board
DAP	Detailed Area Plan
DCC	Dhaka City Corporation
DESWSP	Dhaka Environmentally Sustainable Water Supply Project
DMDP	Dhaka Metropolitan Development Plan
DMP	Drainage Master Plan
DNCC	Dhaka North City Corporation
DNID	Dhaka Narayanganj Demra Flood Control, Drainage & Irrigation Project
DSCC	Dhaka South City Corporation
DWASA	Dhaka Water Supply and Sewerage Authority
FAP	Flood Action Plan
FCD	Flood Control and Drainage
GoB	Government of Bangladesh
GIS	Geographic information system
HWL	Highest Water Level
IWM	Institute of Water Modeling
JICA	Japan International Cooperation Agency
km	Kilometer
km ²	Kilo Meters squared, square kilo meters
LGED	Local Government Engineering Department
LWL	Lowest Water Level
m/s	Meter per second
m ²	Meter squared, square meter
m ³ /s	Cubic meter per second (cumec)
MRT	Mass Rapid Transit
O & M	Operation and Maintenance
PWD	Public Works Department
RAJUK	Rajdhani Unnayan Kartripakkha
RDP	Regional Development Plan
RHD	Roads and Highways Department
SX	Serial Number
SoB	Survey of Bangladesh
ToR	Terms of Reference
WL	Water Level
WQ	Water Quality

CHAPTER 1

INTRODUCTION

1. INTRODUCTION

1.1 BACKGROUND

Water is continually moving around, though, and above the Earth. It moves as water vapor, liquid water, and ice. It is constantly changing its form. Water on Earth is known by different terms, depending on where it is and where it came from. Agricultural operations can be the source of non-point pollution in surface water. The major causes of surface water pollution associated with farming and ranching are sediment and nutrients. Soil erosion and resulting sedimentation is the leading cause of surface water pollution. Siltation is the leading cause of water quality problems in rivers. Although soil erosion is a natural process, it can be greatly accelerated by human activities such as farming. Major sources of sediment include runoff from cropland, forestry and urban/suburban development are the key points for surface water pollution.

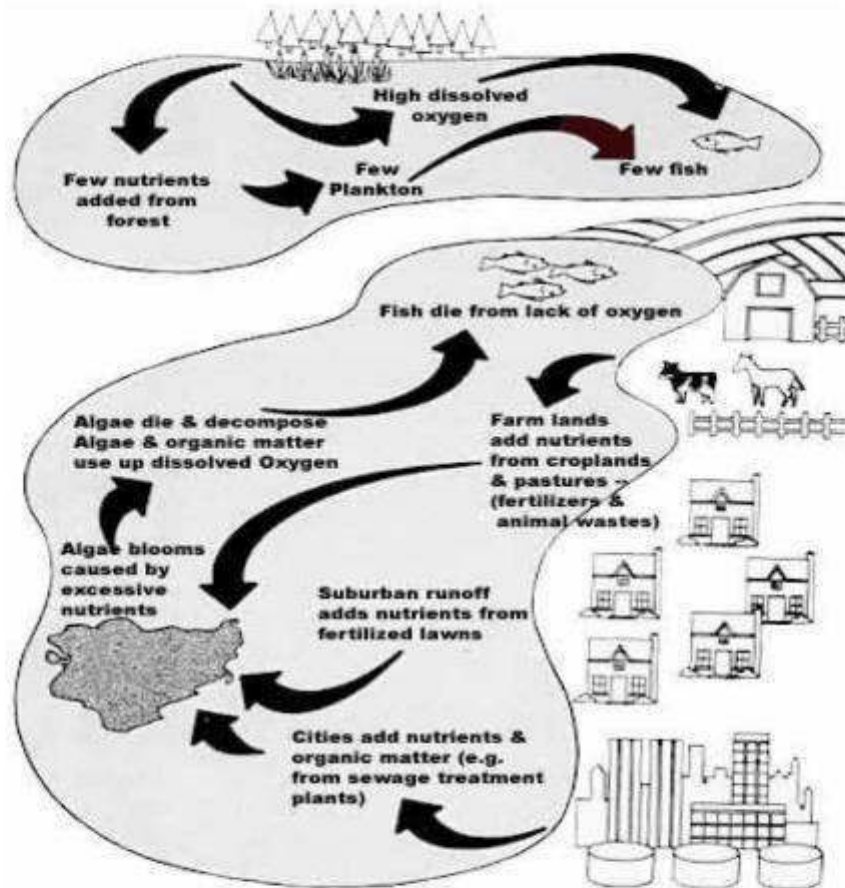


Figure 1:1 Schematic diagram- Different source for Surface water pollution

Water quality monitoring is an important aspect of overall water quality management and water resource development. A well-planned and well-managed water quality monitoring system is required to signal, control or predict the changes or trends in the quality of a particular water body, so that curative or preventive measures can be taken to restore and maintain water body properly. Monitoring is essential for the successful implementation of environmental legislation: to ensure the standards (BD Standard, Annex-1) and criteria set by government are being maintained on a continuing basis. Monitoring involves the laboratory and /or spot testing of water samples collected from desirable locations both source and supply system.

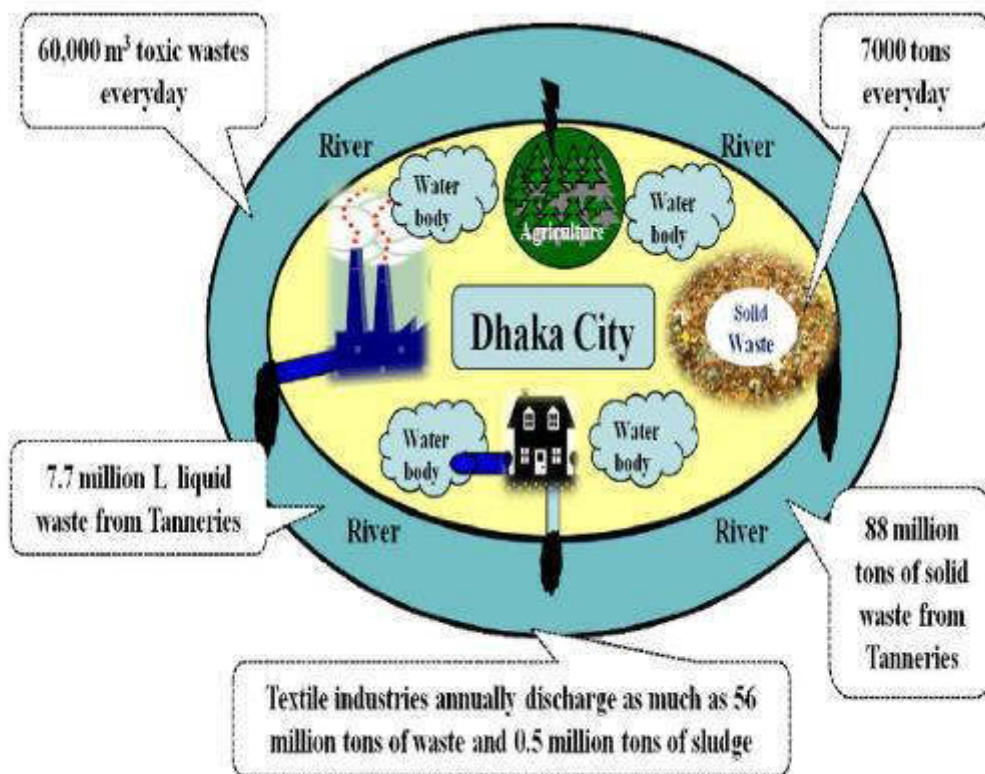


Figure 1:2 Schematic diagram-River pollution around Dhaka City

River pollution around Dhaka City from different sources is exhibited in Figure 1.2. The main sources include industrial untreated wastewater, tannery waste, municipal solid waste, household waste etc. [Article Ref. Environments 2(3):280-294 - June 2015 (Article Alteration of Water Pollution Level) with the Seasonal Changes in Mean Daily Discharge in Three Main Rivers around Dhaka City, Bangladesh]

1.2 OBJECTIVES

There are many instances where surface water does not meet drinking water quality standard due to presence of inferior substances or pollutants. This sort of water should not be introduced in water supply system before treatment. Rainfall (such as acid rain), storm water runoff, agriculture runoff, industrial wastes etc. can affect the color, odor, dissolved oxygen of water and also influences on major ion levels, bacteria level in surface water.

The target of this study is to know the change of surface water quality with respect to time by testing some fundamental parameters, which can represent or can give a synopsis of the given surface water quality before going for a wide scale parameter testing.

To assess the variation of surface water quality over the period of eighteen months for better understanding appropriate surface water treatment facilities for 500MLD capacity of DWASA surface treatment plant which is going to be installed at Bishmondi Araihaazar using Meghna river water to ensure better quality water supply at mega-city Dhaka. In order fulfill the above objective, Onushandhami CREEDS Ltd has been assigned to conduct surface water quality monitoring at proposed intake point at Bishmondi, Bank of Meghna River, Araihaazar under DESWSP, DWASA [RFQW-3.32] for eighteen months.

1.3 SCOPE OF WORKS

The actual works envisaged for implementation are quantified as follows:

1. Conduct hourly, weekly, monthly and seasonal sampling.
2. Conduct some water quality parameter like pH, salinity, conductivity, TDS, hardness, ammonia, color by using portable instrument and test kit
3. Organize laboratory tests for monthly and seasonal sample at DPH Central Lab & BCSIR Lab
4. Data Analysis
5. Result Interpretation
6. Generation and submission of monthly report to DWASA.

1.4 DESCRIPTION OF SAMPLING AREA

Location of the sampling point:

Chaitankanda, Bishmondi Araihaazar

Geo-Coordinates: N=23° 44' 47.107" N, E=90° 43' 00.000"E

Distance from bank of Meghna River: 100m from bank of river where Surface Water Treatment Plant structure place is allocated.

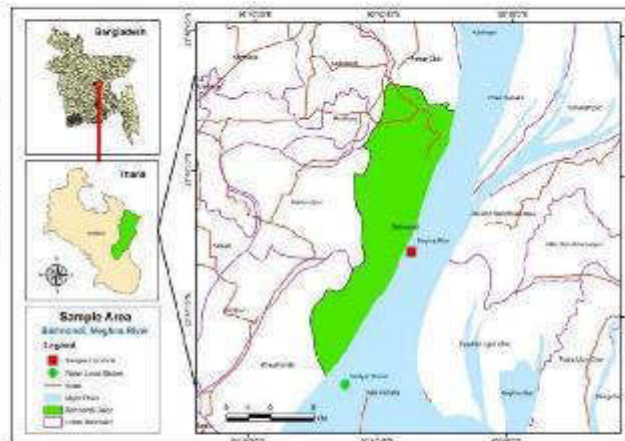


Figure 1:3 Study Area Map of Bishmondi, Araihaazar

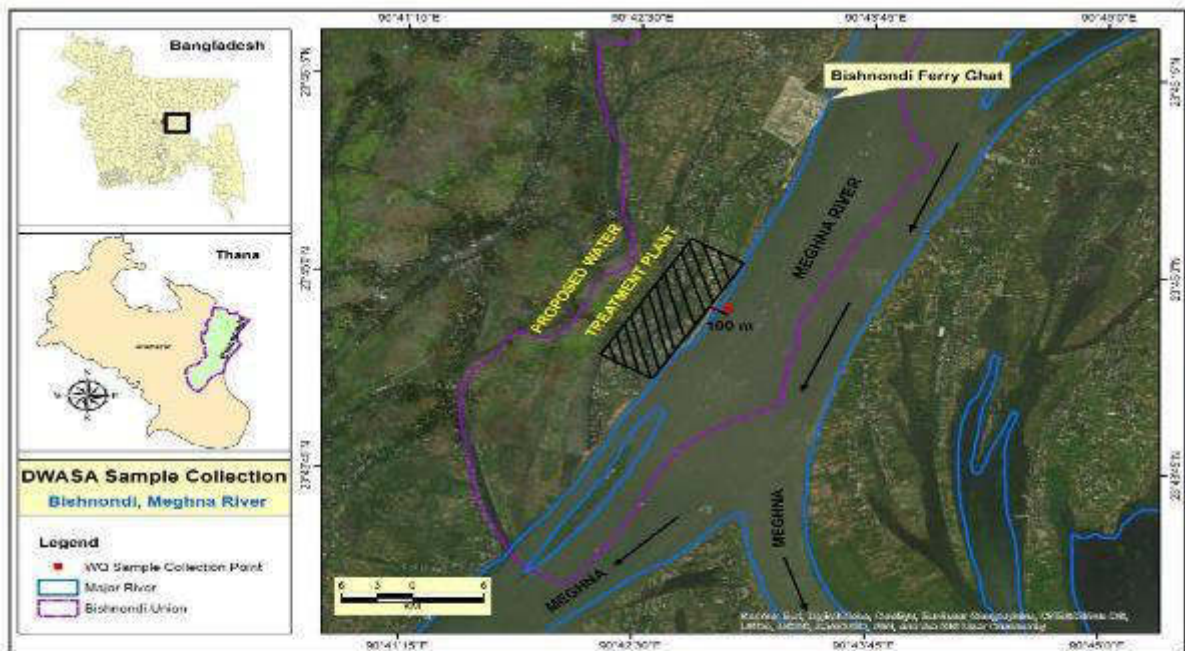


Figure 1:4 Sample collections point of Bishnondi, Arahazar




1.5 Work Plan and Professional Staffing

Schedule of Surface Water Quality Monitoring-Bishnondi, bank of Meghna River,Arihazer

[Chaitankanda, Bishnandi, Geo-Coordinates: N=23° 44' 47.107" N, E=90° 43' 00.000"E]

Duration: July/2019 – Dec/2019; 6months

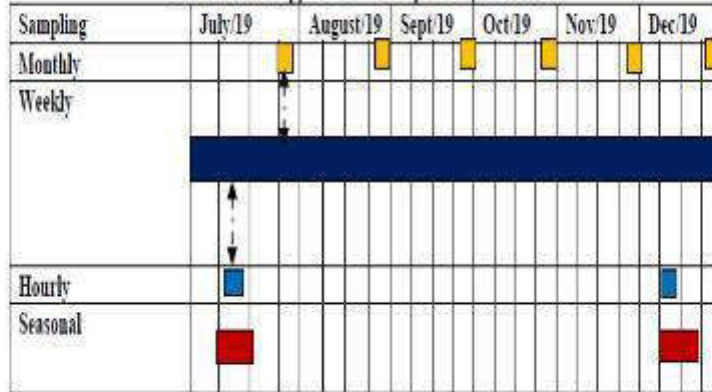

Duration: January/2020 – Dec/2020; 12months

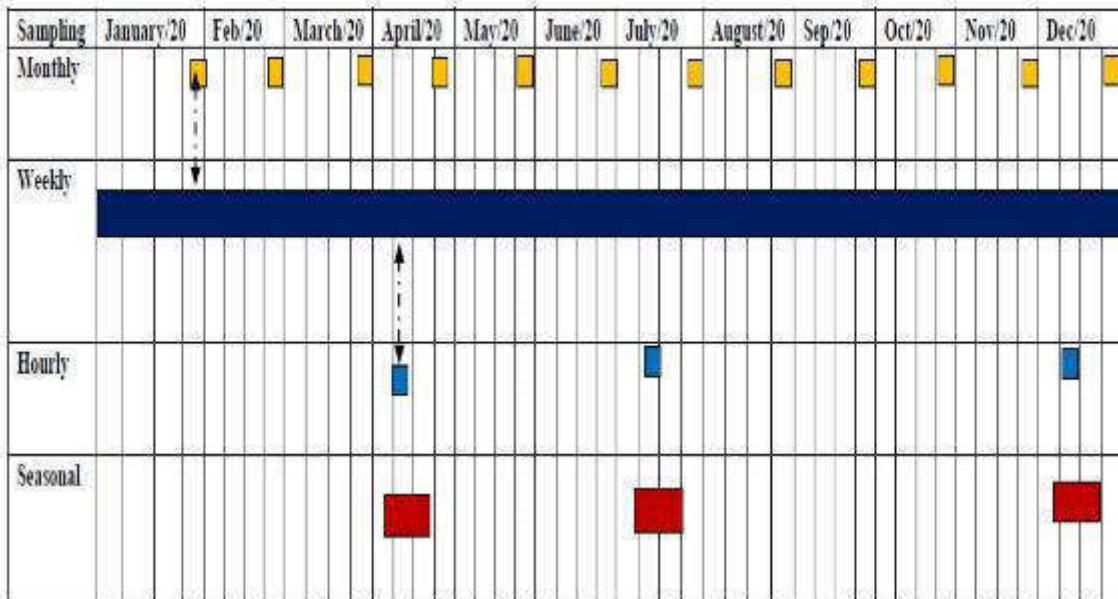


Figure 1:5 Work Plan of the Project



Table 1-1: List of Professional staff involved in this study


Name of The Expert	Position
Dr. Jubair Tariqul Alam Chowdhury	Water Quality /Environment Specialist and Adviser
Dr. Sved Zakir Hossain	River Morphological Specialist
Md. Shahadat Hossain	Water Supply Specialist
Rayaan Jubair Chowdhury	Environmental Engineer
Mohimen Ur Rahman	Water Quality Analyzer
Mansura Khanum	GIS Expert
Mahbubul Alam	Hydro-geologist
Wakil Ahmed	Junior Engineer

Progress Index

Monitoring duration: July/2019 to December/2020

Reporting Month: January/2020

Progress month=Seven months July, August, September, October, November & December/2019 and January/2020

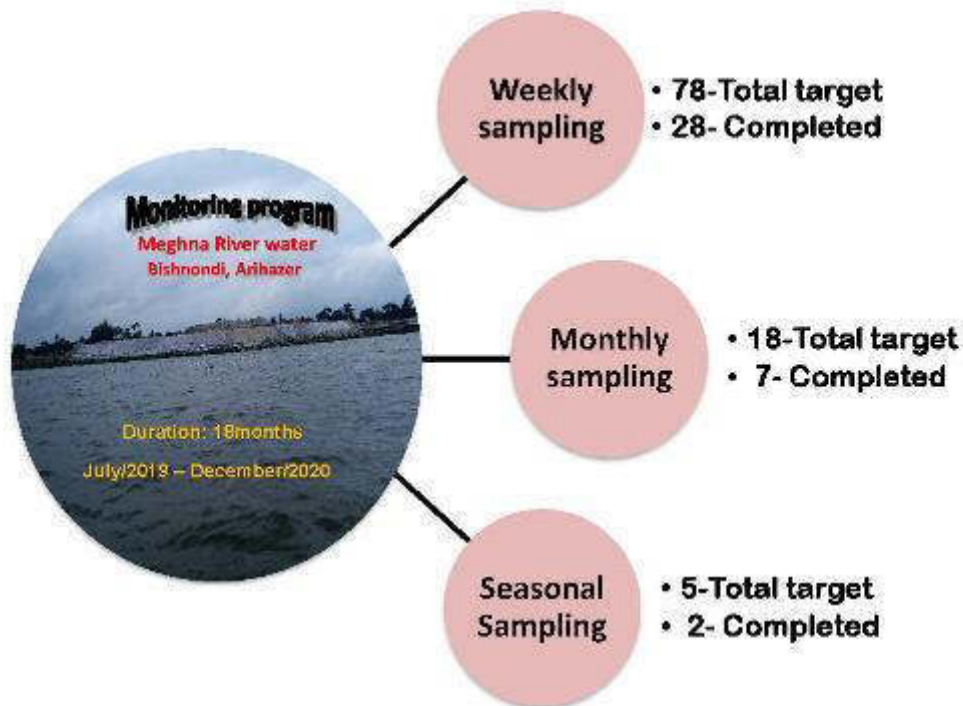



2 METHODOLOGY

The Methods and instruments for different parameter analysis and sample collections were selected by following the standard methods for the examination of water and wastewater proposed by APHA (American Public Health Association), AWWA (American Water Works association) & WEF (Water Environment Federation).

2.1 Sampling Approach and Methodology

a. Sampling point:

The sampling point is located at Bishnondi. GPS location of sampling points is N: 23° 44' 47.107" N, E=90° 43' 00.000"E Distance between sampling point and bank of river is 100meters [minimum river bank in dry season]

b. Water Sample:

- (i) 1st grab water sample should be collected from a depth of 0.5meter every time. Measure some physicochemical parameters (Temperature, pH, Conductivity, Turbidity, Dissolved Oxygen, TDS and Ammonia) at field and record properly.
- (ii) Sample in different depths: Made up of two equal parts collected at predetermined intervals of depth between the surface and probable inlet point of the intake pipe, which is approximately 8m from surface of the river. In this case, another two grab samples (2nd & 3rd Grab) will be collected from equal depth interval and measure some physicochemical parameters (Temperature, pH, Salinity, Conductivity, Turbidity, Dissolved Oxygen, TDS and Ammonia) at field for each grab sample separately and record properly.
- (iii) A composite sample (combining portions of these three multiple grab samples) should be collected for detail chemical and microbiological analysis at laboratory. Composite sample should be composition of three grab samples.
- (iv) Measure physicochemical parameters (Temperature, pH, Salinity, Conductivity, Turbidity, Dissolved Oxygen, TDS and Ammonia) for composite sample, after immediate mixing of the three grab samples (1st, 2nd & 3rd Grab sample), at field and record properly.
- (v) After the field physicochemical measurements have been recorded, collect water samples for laboratory analysis, both chemical and microbiological, at the same location and same depth in same manner. It is mentioned that one grab sample (1st grab sample) and one composite sample (combining portions of 1st, 2nd & 3rd grab sample) should be collected for laboratory analysis during monthly sampling and seasonal variation for special pollutants sampling.
- (vi) Salinity test during high tide: Measure salinity monthly basis during high tide only at Meghna Bridge spot. Measure salinity in three different depths [See b (i) & (ii)]. Additionally, Salinity test (at 4 points): Measure salinity at 4 (four) points in between Meghna Bridge and Intake point of SWTP (Bishnondi) with three equal intervals.



For other parameter analysis at laboratory, the volume of samples and the preservative are (1) four liter-without preservative (2) two liter with HCl as preservative (3) four liter with HNO₃ as preservative.

Water Level: Water Level shall be measured weekly at Bishnondi sampling point. The level should be related to national datum. Other observations should be recorded properly according to a "Field Survey Form".

The following points should be considered during sampling:

- Sampling by Boat: Always collect samples upstream from the boat and as far away from the motor as possible, to minimize the chance of gas or oil contamination. Turn off the engine before collecting samples.
- When samples are collected during abnormally high or low flow, the abnormal conditions should be recorded in the field logbook and on the observation lines of the sample data form. It is important to include flow severity and days since last rainfall rain information with each sampling event. This information is very useful in interpreting the data.
- Upon arrival at the sampling site, record visual observations on the appearance of the water like color, unusual amount of suspended matter, debris or foam etc. and other information related to water quality and water use.
- Weather such as heavy rains, cold front, very dry, very wet etc. information should be recorded.
- Unusual incidences like presence of hydrogen sulfide, sewage and biological activity like excessive phytoplankton or algal growth should be recorded during sample collection and testing at field.
- The sample location should be strictly maintained in the same place during the whole period of this survey. Samples should not be collected during rainfall.
- The required instruments are Multi parameter analyzer, Turbidity meter, Ammonia kit, Flow meter, Depth measurement meter, surface water sampler, HDPE sample bottles, acid, cool box etc.

2.2 Duration of the monitoring:

The tentative duration of the study is 18 months, starting from July 2019 to December 2020.



CHAPTER 3

DESCRIPTION OF SAMPLING

3 DESCRIPTION OF SAMPLING

Following detailed discussion at DWASA office, the field survey for the study was scheduled. After the signing of the project on July 16, 2019, there were three weeks of scheduled weekly sampling.

3.1 Sampling Schedule:

Water sample will be collected under different time frequency such as weekly, monthly, seasonal and hourly. The detailed description is as follow:

Weekly sampling:

Duration: July/2019- Dec/2020; Total week= 78 weeks

Test type: Field-test using field kit and portable instrument. Weekly sample will not send to lab test.

(A) Test type: Field test; [using field kit and portable instrument]

Table 3-1: Field test parameters

Water quality parameter	1 st grab sample	2 nd grab sample	3 rd grab sample	Composite Sample-1	Type of instrument/Kit
Temperature	78	78	78	78	Multi parameters Meter
pH	78	78	78	78	Multi parameters Meter
Salinity	78	78	78	78	Multi parameters Meter
Conductivity	78	78	78	78	Multi parameters Meter
Turbidity	78	78	78	78	Multi parameters Meter
Dissolved Oxygen (DO)	78	78	78	78	Multi parameters Meter
TDS	78	78	78	78	Turbidity meter
Ammonia	78	78	78	78	Ammonia kit
Total Hardness	78	78	78	78	Hardness kit
Color	78	78	78	78	Colorimeter

*Orange Shade=Test by Portable instrument; Blue shade=Test by kit

Monthly sampling:

Duration: July/2019- Dec/2020; Total month= 18 months. Monthly sample will be collected 4th week of each month. Weekly sample of 4th week of each month will also be considered as monthly sample for field parameter.

Type of Test:

- i. **Field test:** Same as before using field kit and portable instrument.
- ii. **Laboratory test:** Sample will be send to DIPEL central lab. Parameters are Nitrate; Nitrite; COD; TSS; BOD₅; Phosphate; Alkalinity; Ammonia; Total Hardness; Arsenic; Iron; Manganese and Aluminum.



Hourly /Seasonal sampling:

13 hourly samples, during daylight time, will be collected five times during study period. Hourly sample will be collected during seasonal sampling.

Test type: Field test [using field kit and portable instrument] and laboratory test

Sampling time: July/2019; Dec/2019; April/2020; July/2020 & Dec/2020

Frequency of sampling = 5times during study period (18 month)

(A) Parameter test at field during hourly sampling including total number:

Table 3-2: Hourly Sampling parameters

Water quality parameter	1 st grab sample	2 nd grab sample	3 rd grab sample	Composite Sample-1	Type of instrument/Kit
Temperature	13x5=65	13x5=65	13x5=65	13x5=65	Multi parameters Meter
pH	13x5=65	13x5=65	13x5=65	13x5=65	Multi parameters Meter
Salinity	13x5=65	13x5=65	13x5=65	13x5=65	Multi parameters Meter
Conductivity	13x5=65	13x5=65	13x5=65	13x5=65	Multi parameters Meter
Dissolved Oxygen (DO)	13x5=65	13x5=65	13x5=65	13x5=65	Multi parameters Meter
TDS (Total Dissolved Solid)	13x5=65	13x5=65	13x5=65	13x5=65	Multi parameters Meter
Turbidity	13x5=65	13x5=65	13x5=65	13x5=65	Turbidity meter
Ammonia	13x5=65	13x5=65	13x5=65	13x5=65	Ammonia kit
Total Hardness	13x5=65	13x5=65	13x5=65	13x5=65	Hardness kit

**13Hours = 13; Season=5; *Orange Shade=Test by Portable instrument; Blue shade=Test by kit*

(B) List of water quality test parameter at laboratory during hourly sampling:

Arsenic; Algae; Antimony; Ammonia; Barium; Boron; Cadmium; Chloride; Chromium (Hexavalent); Coliform (faecal); Copper; BOD_{5days}; COD; Lead; Mercury; Nitrate; Nitrite; Nike; Phosphate; TOC; Pesticides (Organo-chlorine); Pesticides (Organo-phosphorus); Oil & Grease; Fluoride; Selenium; Sulphate; Sodium; Zinc.



3.2 Field Visits

Total of 04 (four) field visits were conducted during September/2019. The field visit schedule along with personnel involved is shown in table

Table 3-3: Field Visit Schedule

Date	Sampling Type	Personnel
04/01/2020	Weekly Sampling	Name: Md. Shahadat Hossain Designation: Water Quality Analysis Specialist
		Name: Mohimen Ur Rahman Designation: Water Quality Analysis Assistant
		Name: Sourav Kanti Paul Designation: Water Quality Analysis Assistant
		Name: Fakhrul Islam Designation: Survey Assistant
11/01/2020	Weekly Sampling	Name: Md. Shahadat Hossain Designation: Water Quality Analysis Specialist
		Name: Mohimen Ur Rahman Designation: Water Quality Analysis Assistant
		Name: Sourav Kanti Paul Designation: Survey Assistant
		Name: Fakhrul Islam Designation: Survey Assistant
18/01/2020	Weekly Sampling	Name: Md. Shahadat Hossain Designation: Water Quality Analysis Specialist
		Name: Rayaan Jubair Chowdhury Designation: Environmental Engineer
		Name: Mohimen Ur Rahman Designation: Water Quality Analysis Assistant
		Name: Sourav Kanti Paul Designation: Survey Assistant
		Name: Fakhrul Islam Designation: Survey Assistant
25/01/2020	Weekly/Monthly Sampling	Name: Mohimen Ur Rahman Designation: Water Quality Analysis Assistant
		Name: Sourav Kanti Paul Designation: Survey Assistant
		Name: Fakhrul Islam Designation: Survey Assistant

**Photo of field sampling activities are shown in Annexures-3.*

3.3 Laboratory Tests

(A) Laboratory test during monthly sampling including name of the parameter, total number of samples, type of sample and name of the lab are as below:

Table 3-4: Laboratory test parameters for monthly sample

Water quality parameter	Composite Sample	Name of the Lab
Nitrate	18	DPHE Center Lab, Mohakhali
Nitrite	18	
COD	18	
TSS	18	
BOD ₅	18	
Phosphate	18	
Alkalinity	18	
Ammonia	18	
Total Hardness	18	
Arsenic	18	
Iron	18	
Manganese	18	
Aluminium	18	

(B) Laboratory test during hourly sampling including name of the parameter, total number sample, name of the lab is as below:

Table 3-5: Laboratory test parameters for hourly sample

Water quality parameter	Composite Sample	Name of the Lab
Arsenic	5	DPHE
Algae	5	BCSIR
Barium	5	DPHE
Cadmium	5	DPHE
Chloride	5	DPHE
Chromium(Hexavalent)	5	BCSIR
Coliform(fecal)	5	DPHE
BOD	5	DPHE
COD	5	DPHE
Lead	5	DPHE
Mercury	5	BCSIR
Ammonia	5	DPHE
Nitrate	5	DPHE
Nitrite	5	DPHE
Phosphate	5	DPHE
TOC	5	BCSIR
Pesticides(Organo-chlorine)	5	BCSIR
Pesticides(Organo-phosphorus)	5	BCSIR
Oil & Grease	5	BCSIR
Fluoride	5	DPHE
Selenium	5	DPHE
Zinc	5	DPHE
Sulphate	5	DPHE
Copper	5	DPHE
Antimony	5	BCSIR
Boron	5	BCSIR
Nikel	5	DPHE
Sodium	5	DPHE



Major instrument for use in Lab

The below major instrument will be used during laboratory analysis as per “Standard Methods- For the Examination of Water and Wastewater”, 20th Edition; Prepared & Published by American Public Health Association (APHA); American Water Works Association (AWWA) and Water Environment Federation (WEF):

Table 3-6: Laboratory test equipment used for test

Parameter	Major equipment for test
Aluminum	Atomic absorption spectrophotometer
Alkalinity	Ion meter/ UV-Visible Spectrophotometer
Arsenic	Atomic absorption spectrophotometer (HVG)
Barium	Atomic absorption spectrophotometer
Cadmium	Atomic absorption spectrophotometer (heavy metal)
Chloride	Ion chromatograph (Anion)
Chromium (Hexavalent)	Ion chromatograph (Hexavalent chrome)
COD	COD Reactor, burette stand.
BOD5 20 °C	Incubator, BOD bottle
Coliform (Fecal)	Autoclave, incubator, filtration unit.
Lead	Atomic absorption spectrophotometer (heavy metal)
Mercury	Atomic absorption spectrophotometer for Hg analysis
Nitrate	Ion chromatograph (Anion)/UV-Visible Spectrophotometer
Nitrite	Ion chromatograph (Anion)/UV-Visible Spectrophotometer
Phosphate	Ion chromatograph (Anion)/ UV-Visible Spectrophotometer
S.S	Balance, Dehydrator, Desiccators, filtration unit
Sulfate	Ion chromatograph (Anion)/ UV-Visible Spectrophotometer
Silica	UV-Visible Spectrophotometer
Total dissolved solids	Balance, Dehydrator, Desiccators, filtration unit
Zinc	Atomic absorption spectrophotometer
TOC	TOC analyzer
Pesticides (Organo Chlorine)	GC-MS
Pesticides (Organo Phosphorus)	GC-MS
Oil & Grease	Solvent Extraction



Figure 3:1 Central Laboratory, DPHE, Mohakhali, Dhaka



Figure 3:2 Bangladesh Council for Scientific and Industrial Research (BCSIR)



3.4 List of portable instrument/ Test kit and others use during field activities:

The following items are required for the Water Quality Monitoring activities:

- a. Multi parameters Meter (for pH, DO, Electrical Conductivity (EC), TDS. In addition, salinity test) HACH, USA.
- b. Turbidity meter for the measurement of Turbidity, HACH, USA.
- c. Testing Kits for NH₃-N, As, Hardness, Alkalinity tests
- d. Sampling bottles (different sizes)
- e. Distilled water
- f. Different acids (HCl, HNO₃) for sample preservation, washing of sample bottle etc.
- g. Required glassware, washing bottle etc.

3.5 Field Survey data form:

A field survey data form has been developed which is shown in the Annexure-1 section of this report.

3.6 Drinking Water Quality Standard:

Bangladesh Drinking Water Quality standards [ENVIRONMENT CONSERVATION RULES 1997. Published: 28th August, 1997, Government of the People's Republic of Bangladesh; Ministry of Environment] are shown in the Annexure-2 section of the report.



CHAPTER 4

RESULTS AND DISCUSSIONS

4 RESULTS AND DISCUSSIONS

4.1 Weekly sampling- Field test results

Table 4-1: Weekly Sampling Field Test Results: Sampling date: 04-01-2020

Water quality field test parameters (weekly sample)											
Date: 04-01-2020						Time: 10 am -12 pm					
Sample	Dept(m)	Temp (°C)	pH	Salinity (‰)	Cond. (µS/cm)	TDS (mg/l)	DO (mg/l)	Turbidity (NTU)	Hardness (mg/l)	NH3 (mg/l)	Color (Pt/Co)
1st grab sample	0.5	21.7	7.6	0.05	116.7	55.7	8.08	15.52	60	0.48	198
2nd grab sample	4	20.5	7.6	0.05	106.7	50.3	8.18	15.55	60	0.55	201
3rd grab sample	8	20.6	7.4	0.03	105.2	49.7	8.55	16.11	60	0.58	200
Composite sample	-	20.7	7.6	0.05	106.9	50.5	8.97	15.96	60	0.56	201
Min(Grab Sample)	-	20.5	7.4	0.03	105.2	49.7	8.08	15.52	60	0.48	198
Max(Grab Sample)	-	21.7	7.6	0.05	116.7	55.7	8.55	16.11	60	0.58	201
Avg(Grab Sample)	-	20.93	7.53	0.04	109.53	51.90	8.27	15.73	60.00	0.54	199.67
Stdi(Grab Sample)	-	0.67	0.12	0.01	6.25	3.30	0.25	0.33	0.00	0.05	1.53

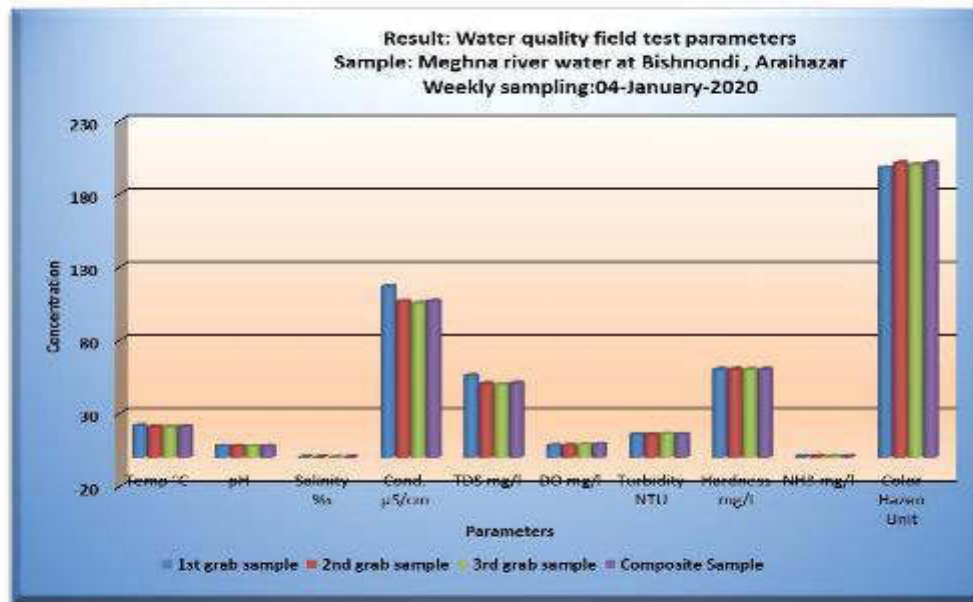


Figure 4-1 Comparison of different water quality parameters at different depth, 1st week.



Table 4-2: Weekly Sampling Field Test Results: Sampling date:11/01/2020

Water quality field test parameters (weekly sample)											
Date: 11-01-2020						Time: 10 am -12 pm					
Sample	Dept(m)	Temp (°C)	pH	Salinity (‰)	Cond. (µS/cm)	TDS (mg/l)	DO (mg/l)	Turbidity (NTU)	Hardness (mg/l)	NH3 (mg/l)	Color(Pt/Co)
1st grab sample	0.5	19.3	7.4	0.05	112.3	53	8.25	12.32	60	0.59	110
2nd grab sample	4	19	7.2	0.05	112	52.9	8.4	13.69	40	0.61	105
3rd grab sample	8	19.3	7.2	0.03	113.8	53.2	8.5	13.79	60	0.61	102
Composite sample	-	19	7.2	0.05	121.1	53	8.5	13.78	60	0.56	101
Min(Grab Sample)	-	19	7.2	0.03	112	52.9	8.25	12.32	40	0.59	102
Max(Grab Sample)	-	19.3	7.4	0.05	113.8	53.2	8.5	13.79	60	0.61	110
Avg(Grab Sample)	-	19.20	7.27	0.04	112.70	53.03	8.38	13.27	53.33	0.60	105.67
Std(Grab Sample)	-	0.17	0.12	0.01	0.96	0.15	0.13	0.82	11.55	0.01	4.04

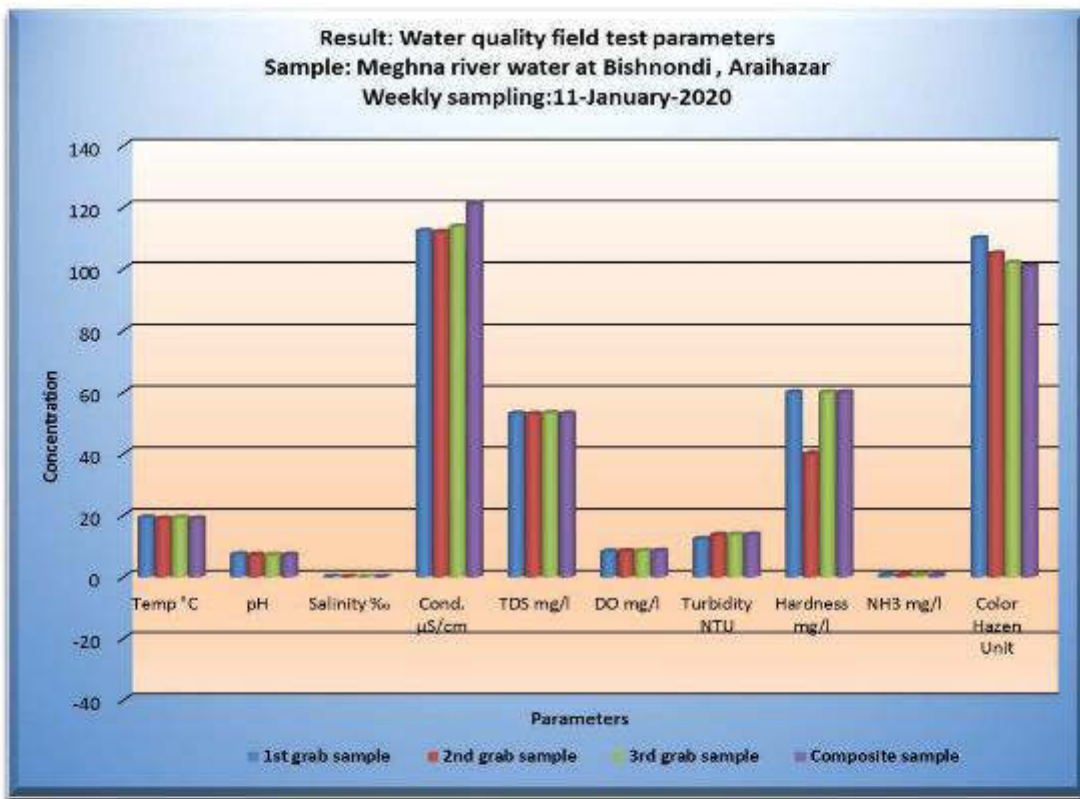


Figure 4-2: Comparison of different water quality parameters at different depth; 2nd week.



Table 4-3: Weekly Sampling Field Test Results: Sampling date: 18/01/2020

Water quality field test parameters (weekly sample)											
Date: 18-01-2020						Time: 10 am -12 pm					
Sample	Dept(m)	Temp (°C)	pH	Salinity (‰)	Cond. (µS/cm)	TDS (mg/l)	DO (mg/l)	Turbidity (NTU)	Hardness (mg/l)	NH3 (mg/l)	Color(Pt/Co)
1st grab sample	0.5	24.1	7.5	0.06	117	55.8	7.48	15.52	60	0.48	97
2nd grab sample	4	23.2	7.3	0.06	127.4	60.1	7.22	14.8	40	0.51	95
3rd grab sample	8	22.3	7.2	0.06	128.6	61.6	7.58	14.83	60	0.45	92
Composite sample	-	21.9	7.2	0.06	126.7	59.9	7.98	15.07	60	0.49	94
Min.(Grab Sample)	-	22.3	7.2	0.06	117	55.8	7.22	14.8	40	0.45	92
Max.(Grab Sample)	-	24.1	7.5	0.06	128.6	61.6	7.58	15.52	60	0.51	97
Avg.(Grab Sample)	-	23.20	7.33	0.06	124.33	59.17	7.43	15.05	53.33	0.48	94.67
Std.(Grab Sample)	-	0.90	0.15	0.00	6.38	3.01	0.19	0.41	11.55	0.03	2.52

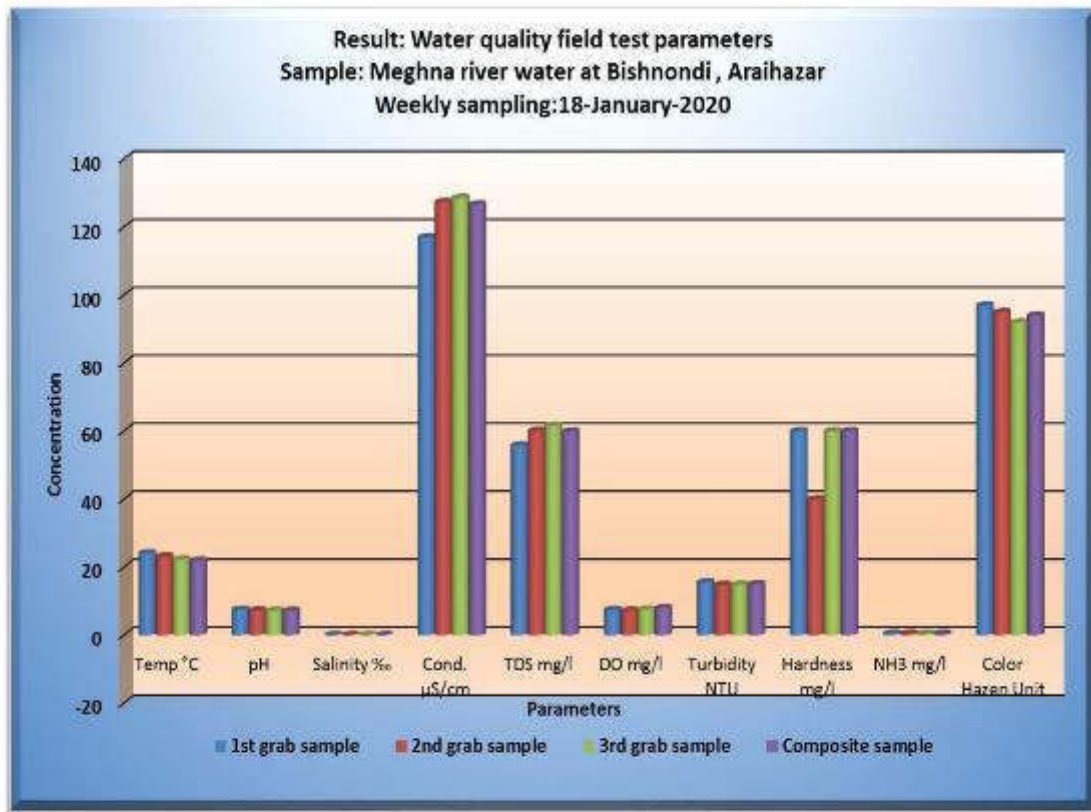


Figure 4.3 Comparison of different water quality parameters at different depth; 3rd week.



Table 4-4: Weekly Sampling Field Test Results: Sampling date: 25/01/2020

Water quality field test parameters (weekly sample)											
Date: 25-01-2020						Time: 10 am -12 pm					
Sample	Dept(m)	Temp (°C)	pH	Salinity (‰)	Cond. (µS/cm)	TDS (mg/l)	DO (mg/l)	Turbidity (NTU)	Hardness (mg/l)	NH3 (mg/l)	Color (Pt/Co)
1st grab sample	0.5	23	7.6	0.05	116.6	54.6	7.82	10.81	80	0.71	182
2nd grab sample	4	20.2	0.4	0.05	116.6	55.3	8.4	12.33	60	0.72	178
3rd grab sample	8	20.2	7.3	0.03	118.3	55.9	8.7	11.46	60	0.68	178
Composite sample	-	20	7.3	0.05	117.8	55.7	8.61	10.26	60	0.7	179
Min (Grab Sample)	-	20.2	0.4	0.03	116.6	54.6	7.82	10.81	60	0.68	178
Max (Grab Sample)	-	23	7.6	0.05	118.3	55.9	8.7	12.33	80	0.72	182
Avg (Grab Sample)	-	21.13	5.1	0.04	117.17	55.27	8.31	11.53	66.67	0.70	179.33
Std (Grab Sample)	-	1.52	4.07	0.01	0.98	0.65	0.45	0.76	11.55	0.02	2.31

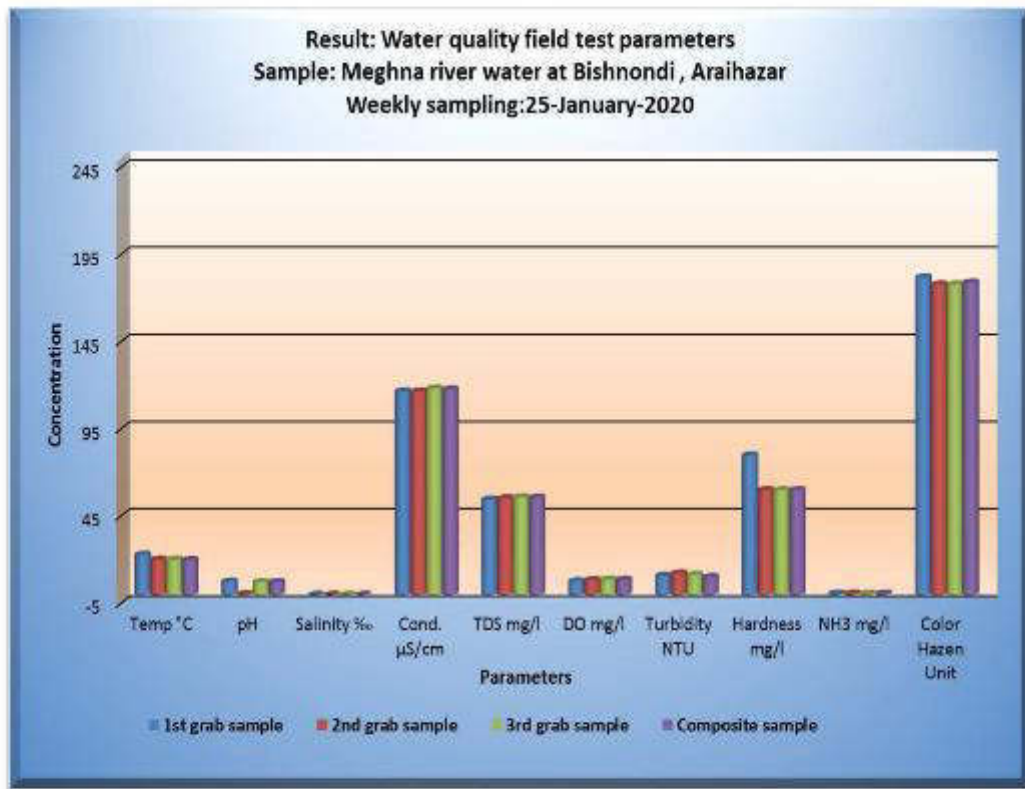


Figure 4.4 Comparison of different water quality parameters at different depth; 4th week



4.2 Laboratory Test Results- Monthly Sample

Water quality Laboratory test result- Monthly sample; Composite sample					
Test conducted by: DPHE Central Laboratory, Mohakhali, Dhaka					
4 th - Monthly sample: January/2020					
Date: 27-01-2020		Composite sample Depth= [Sample-1: 0.5m+Sample-2: 4m+Sample-3: 8m]			
Water quality parameters	Bangladesh Standard	Concentration present	Unit	Analysis Method	LOQ
Alkalinity		87	mg/L	Titrimetric	
Aluminum	0.2	0.18	mg/L	AAS	0.002
Ammonia	0.5	0.62	mg/L	UVS	0.1
Arsenic (As)	0.05	0.001	mg/L	AAS	0.001
Biochemical Oxygen Demand (BOD)	0.2	2	mg/L	days Incubation	0.1
Chemical Oxygen Demand (COD)	4	4	mg/L	CRM	
Hardness	200-500	60	mg/L	Titrimetric	
Iron (Fe)	0.3-1	0.3	mg/L	AAS	0.05
Manganese (Mn)	0.1	0.03	mg/L	AAS	0.03
Nitrogen (Nitrate)	10	2.1	mg/L	UVS	0.1
Nitrogen (Nitrite)	<1.0	0.03	mg/L	UVS	0.02
Phosphate	6	0.45	mg/L	UVS	0.1
Total Suspended Solid (TSS)	10	2	mg/L	Gravimetric Method	

CHAPTER 5

CONCLUSION

5 CONCLUSION

BOD and COD have been observed to have higher trend in monthly sample. Low BOD and COD value is an indicator of good quality water, while high value indicates polluted water. Bacteria consume dissolved oxygen (DO) when large amounts of organic matter from sewage or other discharges are present in the water.

BOD and COD tests result during monthly sample analysis by laboratory have been found to be 2mg/L and 4mg/L, respectively. This value is higher than the BD standard value of BOD. COD is within the BD standard. *This trend can be explained by the flow and velocity of the river.* Low flow during the wet season hinders washout and thus BOD value increases. This conclusion is bolstered by studies of other rivers in Bangladesh (e.g. Jamuna has same trend during dry and wet season).

Decrease in dissolved oxygen (DO) is usually precedent by increase in ammonia and BOD. During this month, the DO was an average of **8.5 mg/L**, and ammonia was **0.62mg/L**. Although ammonia concentration is high, the value of DO also seems to be higher. The reason for this is because there is an inverse relation between temperature and DO. Since the temperature during December tends to be lower, the DO concentration tends to be higher.

It has been observed that there is an increase in total suspended solid (TSS) from August to September (4.3 mg/L to 6 mg/L) but remained almost same in October (5 mg/L) and dropped significantly on November to December (1 mg/L) and slightly increased in January (2mg/L). This decrease might occur due to the decrease in flow of river but further data and analysis is required.

In order to provide an overall quality of water, Water Quality Index (WQI) has been calculated for the weekly and monthly samples. A Water Quality Index (WQI) is a means by which water quality data is summarized for reporting to the public in a consistent manner. A chart has been provided below for the water quality classification based on WQI.

Water quality classification based on WQI value.

Class	WQI Value	Water Quality Status
A	<50	Excellent
B	51-100	Good
C	101-200	Poor
D	201-300	Very Poor
E	>300	Water Unsuitable for Drinking

The WQI value for the weekly samples was **131.8(1st week)**, **131.2(2nd week)**, **103.2(3rd week)**, **148.3(4th week)** and respectively. The higher WQI value was contributed by the increase in turbidity and color but it remained almost constant throughout the month. The WQI value for the monthly sample was **141.5**. The contributing pollutants were COD and BOD for the increase in WQI value in monthly than from weekly (4th week). **The monthly WQI value is high and has almost remained constant from the preceding month.**



ANNEXURES



ANNEXURES

ANNEXURE-1: Field Survey Data Form

DWASA Surface Water Quality Monitoring Program

(1) Sample location : Bishnondi (Bank of Meghna River), Arihazer

[Chaitankanda, Bishnandi, Geo-Coordinates: N=23° 44' 47.107" N, E=90° 43' 00.000" E]

[Distance: 109m from bank of river where SWTP structure place is allocated]

(2) Field Observations:

Upon arrival at a sampling site, record visual observations on the appearance of the water and other information related to water quality and water use as below:

Parameter	Observation
a. Water Colour	Greenish /reddish / yellowish / Muddy / Colour less
b. Water appearance	Unusual amount of suspended matter / debris / foam
c. Rain fall	Heavy / Medium/ Low / None
d. Day	Cloudy day/ very dry/very wet
e. Unusual Odors	Hydrogen sulfide odor/ musty odor /sewage odor/ none
f. Biological Activity	Excessive growth of algal / Phytoplankton/ others..... / none

(3) Water quality field test parameters (Weekly sample / Monthly sample)

Date:

Time:

Sample	Depth (m)	Temp °C	pH	Salinity %	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH ₃ mg/l	Color	Flow ft ³ /s
1 st grab sample	0.5											
2 nd grab sample	4											
3 rd grab sample	8											
Composite Sample (1 st +2 nd +3 rd Grab sample)												

Note-1:

Field test parameters (Weekly & Monthly): Temp=Temperature; pH; Salinity; Cond=Conductivity; DO=Dissolved Oxygen; Turbidity; TDS=Total Dissolve Solid; Hardness; NH₃ - Ammonia; Color

Note-2:

Lab test parameters (Monthly sampling): Nitrate, Nitrite; COD, TSS, BOD₅, Phosphate; Alkalinity; Ammonia; Total Hardness; Arsenic; Iron; Manganese; Aluminum

(4) Seasonal Sample:



(4.A) Water quality field test parameters (Hourly sampling-1st grab sample)

Date:

Depth: 0.5meter

Time	Temp. °C	pH	Salinity %	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH ₃ mg/l	Color	Flow l/s
6AM											
7AM											
8AM											
9AM											
10AM											
11AM											
12											
1PM											
2PM											
3PM											
4PM											
5PM											
6PM											

Note-3:
Seasonal Sampling (Composite sample) for Lab Test: Arsenic; Algae; Barium; Cadmium; Chloride; Chromium(Hexavalent); Coliform(fecal); BOD; COD; Lead; Mercury; Ammonia; Nitrate; Nitrite; Phosphate; TOC; Pesticides (Organo-chlorine); Pesticides (Organo-phosphorus); Oil & Grease; Fluoride; Selenium; Zinc; Sulphate; Copper; Antimony; Boron; Nickel and Sodium.

Note-4:
Hourly sample will be collected during seasonal sampling.

Note-5:
Sample volume and preservative:
(a) Non-preservative sample – four liter
(b) Preservative-HCl – One liter
(c) Preservative-HNO₃ – Two liter
(d) Preservative-H₂SO₄ –One liter



(4.B) Water quality field test parameters (Hourly sampling -2nd grab sample)

Date:

Depth: 4 meter

Time	Temp. °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH ₄ mg/l	Color	Flow ft ³ /s
6AM											
7AM											
8AM											
9AM											
10AM											
11AM											
12											
1PM											
2PM											
3PM											
4PM											
5PM											
6PM											

(4.C) Water quality field test parameters (Hourly sampling: 3rd grab sample)

Date:

Depth: 8 meter

Time	Temp. °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH ₄ mg/l	Color	Flow ft ³ /s
6AM											
7AM											
8AM											
9AM											
10AM											
11AM											
12											
1PM											
2PM											
3PM											
4PM											
5PM											
6PM											



(4.D) Water quality test parameters (Hourly sampling - Composite sample)

Date: _____ **Depth= [Sample-1:0.05m+ Sample-2:4m+ Sample-3: 8m]**

Time	Temp. °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH ₃ mg/l	Color	Flow l ³ /s
6AM											
7AM											
8AM											
9AM											
10AM											
11AM											
12											
1PM											
2PM											
3PM											
4PM											
5PM											
6PM											

4) Any other observations/comments:

Performed by (O.CREEDS):

Date:

Name:

Designation

Signature

--	--	--

PMU Staff:

Name

Designation

Signature

--	--	--



Annexure-2: Bangladesh Drinking Water Quality standards

ENVIRONMENT CONSERVATION RULES 1997

Published: 28th August, 1997

Government of the Peoples' Republic of Bangladesh

Ministry of Environment

SL	Parameter	Unit	Standard
1	Aluminum	mg/l.	0.2
2	Ammonia	"	0.5
3	Arsenic	"	0.05
4	Barium	"	0.01
5	Benzene	"	0.01
6	BOD5 20 °C	"	0.2
7	Boron	"	1.0
8	Cadmium	"	0.005
9	Calcium	"	75
10	Chloride	"	150-600*
11	Chlorinated alkenes carbon tetrachloride	"	0.01
	1.1 Dichloroethylene	"	0.001
	1.2 Dichloroethylene	"	0.03
	Tetrachloroethylene	"	0.03
	Trichloroethylene	"	0.09
12	Chlorinated phenols pentachlorophenol	"	0.03
	2,4,6 Trichlorophenol	"	0.03
13	Chlorine(residual)	"	0.2
14	Chloroform	"	0.09
15	Chromium (Hexavalent)	"	0.05
16	Chromium (Total)	"	0.05
17	COD	"	4
18	Coliform (Focal)	n/100 ml	0
19	Coliform (total) * At sea beach 1000	n/100 ml	0
20	Color	Hazen Unit	15
21	Copper	mg/l.	1.0
22	Cyanide	"	0.1
23	Detergent	"	0.2
24	D.O	"	6.0
25	Fluoride	"	1.0
26	Hardness (as CaCO3)	"	200- 500
27	Iron	mg/l.	0.3-1.0
28	Kjeldahl nitrogen (Total)	"	1.0
29	Lead	"	0.05
30	Magnesium	"	30-35
31	Manganese	"	0.1
32	Mercury	"	0.001
33	Nickel	"	0.1



SL	Parameter	Unit	Standard
34	Nitrate	"	10
35	Nitrite	"	<1.0
36	Odor	"	Odorless
37	Oil and Grease	"	0.01
38	pH	"	6.5-8.5
39	Phenol compounds	"	0.002
40	Phosphate	"	6
41	Phosphorus	"	0
42	Potassium	"	12
43	Radioactive substances (Total-radiation)	Bq/l	0.01
44	Total B B-radiation		0.1
45	Selenium	mg/l	0.01
46	Silver	"	0.02
47	Sodium	"	200
48	S.S	"	10
49	Sulfide	"	0
50	Sulfate	"	400
51	Total dissolved solids	"	1000
52	Temperature	°C	20-30
53	Tin	mg/l	2
54	Turbidity	JTU/NTU	10
55	Zinc	mg/l	5

* Chloride= 1000mg/l (for coastal Area)



ANNEXURE-3: PHOTOGRAPH DURING FIELD SAMPLING IN DIFFERENT DATE



Figure: Weekly Sampling on 04/01/2020



Figure: Weekly Sampling on 11/01/2019



Figure: Weekly Sampling on 18/01/2020



Figure: Weekly Sampling on 25/01/2020




Figure: Monthly/weekly Sampling on 25/01/2020



ANNEXURE-4: FIELD SURVEY DATA FORMS

Date: 04-01-2020



O.CREEDS

ONUSONDHANI CREEDS

Field Survey Data Form

DWASA Surface Water Quality Monitoring Program

(1) Sample location : Bishondi (Bank of Meghna River), Anshaz
[Chaitankunda, Bishondi, Geo Coordinates: N=23°44'47.107" N, E=90°43'00.000" E]
[Distance: 100m from bank of river where SWTP structure place is allocated]

(2) Field Observations:
 Upon arrival at a sampling site, record visual observations on the appearance of the water and other information related to water quality and water use as follows:

Parameter	Observation
a. Water Color	Greenish reddish / yellowish / muddy / colorless
b. Water appearance	Unusual amount of suspended matter / debris / foam / none
c. Rain fall	Heavy / medium low / none
d. Day	Cloudy / dry / very dry / very wet
e. Unusual Odors	Hydrogen sulfide odor / musty odor / sewage odor / etc
f. Biological Activity	Excessive growth of algae / phytoplankton / others / none

(3) Water quality field test parameters (Weekly sample / Monthly sample)
 Date: 4-01-2020 Time: 10 AM - 12 PM

Sample	Depth (m)	Temp (°C)	pH	Salinity (‰)	Cond. (µS/cm)	TDS (mg/l)	DO (mg/l)	Turbidity (NTU)	Hardness (mg/l)	NH ₄ (mg/l)	Color (PCU)	Flow (m ³ /d)
1 st grab sample	0.5	21.7	7.60	0.5	146.7	75.73	0.8	15.62	60	0.48	198	
2 nd grab sample	1	20.5	7.60	0.5	166.7	76.98	1.8	15.87	60	0.55	201	
3 rd grab sample	2	20.6	7.40	0.5	105.2	49.73	1.6	11.60	60	0.58	200	
Composite Sample (1 st , 2 nd , 3 rd Grab sample)		20.7	7.60	0.5	166.9	76.97	1.7	15.96	60	0.56	201	

Note 1:
 Field test parameters (Weekly & Monthly): Temperature; pH; Salinity; Cond-Conductivity; DO-Dissolved Oxygen; Turbidity; TDS-Total Dissolve Solid; Hardness; NH₄-Ammonia; Color

Note 2:
 Lab test parameters (Monthly sampling): Nitrate; Nitrite; COD; TSS; BOD; Phosphate; Alkalinity; Ammonia; Total Hardness; Arsenic; Iron; Manganese; Aluminum

House # 135, Road # 05, 3rd Floor, Mohakhali DOHS, Dhaka-1206
 Contact: +8801712955908 E-mail: ocreedsbd@gmail.com

www.ocreeds.com




 **O.CREEDS**
ONUSONDHANI CREEDS

(4) Any other observations/comments:

RIVER WATER DEPTHS 160cm


Water Quality/ Environmental Specialist
Name: Md. Shahadat Hossain
Date: 04/01/2020


Water Quality Analyzer
Name: Md. Monir Uddin Rahman
Date: 04/01/2020

DWASA PMU Representative
Name:
Designation:
Date:

House # 135, Road # 05, 3rd Floor, Mehakhali DOMS, Dhaka-1206
Contact: +8801712955908 E-mail: ocreedsbd@gmail.com www.ocreeds.com



Date: 11-01-2020



O.CREEDS

ONUSONDHANI CREEDS

Field Survey Data Form

DWASA Surface Water Quality Monitoring Program

(1) Sample location : Bishnadi (Bank of Meghna River), Arihazer
 (Cr. tankanda, Bishnadi, Geo-Coordinates: N=23°44'37.127" N, E=90°43'00.000" E)
 (Distance: 200m from bank of river where SAMP structure place is allocated)

(2) Field Observations:
 Upon arrival at a sampling site, record visual observations on the appearance of the water and other information related to water quality and water use as below:

Parameter	Observation
a. Water Color	Greenish reddish / yellowish / muddy / colorless
b. Water appearance	Unusual amount of suspended matter / debris / foam / none
c. Rain fall	Heavy / medium / low / none
d. Day	Cloudy / day / very dry / very wet
e. Unusual Odors	Hydrogen sulfide odor / musty odor / sewage odor / none
f. Biological Activity	Excessive growth of algae / phytoplankton / others / none

(3) Water quality field test parameters (Weekly sample / Monthly sample)

Date: 11/01/20

Time: 10 AM - 12 PM

Sample	Depth (m)	Temp (°C)	pH	Salinity (‰)	Cond. (µS/cm)	TDS (mg/l)	DO (mg/l)	Turbidity (NTU)	Hardness (mg/l)	NH ₄ (mg/l)	Color (PCU)	Flow (l/s)
1 st grab sample	0.3	19.3	7.4	0.05	112.3	63.0	6.25	18.30	60	0.59	110	
2 nd grab sample	4	19.0	7.2	0.05	112	62.9	8.40	13.69	40	0.61	105	
3 rd grab sample	8	19.3	7.2	0.05	113.8	63.2	8.6	13.79	60	0.61	102	
Composite Sample (1 st -3 rd Grab sample)		19.0	7.2	0.05	113.1	63.0	8.56	13.78	60			

Note 1:

Field test parameters (Weekly & Monthly): Temp=Temperature; pH=Salinity; Cond=Conductivity; DO=Dissolved Oxygen; Turbidity; TDS=Total Dissolve Solid; Hardness; NH₄=Ammonia; Color

Note 2:

Lab test parameters (Monthly sampling): Nitrate; Nitrite; COD; Fe; BOD; Phosphate; Alkalinity; Ammonia; Total Hardness; Arsenic; Iron; Manganese; Aluminium

House # 135, Road # 05, 3rd Floor, Mohakhali DOHS, Dhaka-1206
 Contact: +8801712959908 E-mail: ocreedsbd@gmail.com

www.ocreeds.com



O.CREEDS

ONUSONDHANI CREEDS

(4) Any other observations/comments:

River Water Depth: 16.3 m

Water Quality/ Environmental Specialist

Name: Md. Shahadat Hossain

Date: 04/01/20

Water Quality Analyzer

Name: Ishraqe Bin Khalil

Date: 11/01/20

DWASA PMU Representative

Name:

Designation:

Date:

House #135, Road # 05, 3rd Floor, Mohakhali DOHS, Dhaka-1206
Contact: +8801712955908 E mail: ocreedsbd@gmail.com

www.ocreeds.com



Date: 18-01-2020



O.CREEDS

ONUSONDHANI CREEDS

Field Survey Data Form

DWASA Surface Water Quality Monitoring Program

(1) Sample location : Bishnadi (Banks of Meghna River), Anshaz
 [Chaitankanda, Bishnadi, Geo-Coordinates: N=23°44'37.107"N, E=90°42'00.000"E]
 [Distance: 100m from bank of river where SWTP structure piece is allocated]

(2) Field Observations:

Upon arrival at a sampling site, record visual observations on the appearance of the water and other information related to water quality and water use as below:

Parameter	Observation
a. Water Color	Greenish / reddish / yellowish / muddy / colorless
b. Water appearance	Unusual amount of suspended matter / debris / foam / none
c. Rain fall	Heavy / medium / low / none
d. Day	Cloudy / day / very dry / very wet
e. Unusual Odors	Hydrogen sulfide odor / musty odor / sewage odor / none
f. Biological Activity	Excessive growth of algae / phytoplankton / others..... / none

(3) Water quality field test parameters (Weekly sample / Monthly sample)

Date: 18/01/20

Time: 10 AM - 12 PM

Sample	Depth (m)	Temp (°C)	pH	Salinity (‰)	Cond. (µS/cm)	TDS (mg/l)	DO (mg/l)	Turbidity (NTU)	Hardness (mg/l)	NH ₄ (mg/l)	Color (TCU)	Flow (M ³ /s)
1 st grab sample	0.5	24.1	7.9	0.06	17	60.8	7.98	16.26	60	0.48	97	
2 nd grab sample	4	23.2	7.3	0.06	123.4	60.1	7.22	14.80	40	0.51	95	
3 rd grab sample	8	22.3	7.2	0.06	126.6	61.6	7.58	14.83	60	0.45	92	
Composite Sample (1 st +2 nd +3 rd Grab sample)		21.9	7.2	0.06	126.7	59.9	7.98	16.07	60	0.49	94	

Note-1:

Field test parameters (Weekly & Monthly): Temp-Temperature, pH, Salinity, Cond-Conductivity, DO-Dissolved Oxygen, Turbidity, TDS-Total Dissolve Solid, Hardness, NH₄-Ammonia, Color


Note-2:

Lab test parameters (Monthly sampling): Nitrate, Nitrite, COD, TSS, BOD, Phosphate, Alkalinity, Ammonia, Total Hardness, Arsenic, Iron, Manganese, Aluminium

House # 115, Road # 05, 3rd Floor, Mohakhali DOHS, Dhaka-1206
 Contact: +8801712955908 E-mail: ocreedsbd@gmail.com

www.ocreeds.com






O.CREEDS


ONUSONDHANI CREEDS

(4) Any other observations/comments:

River water depth: 16.3 m



Water Quality/ Environmental Specialist
Name: Md. Shahadat Hossain
Date: 18/01/20



Water Quality Analyzer
Name: Ishraque Bin Khalil
Date: 18/01/20

DWASA PMU Representative

Name: _____

Designation: _____

Date: _____

House # 135, Road # 05, 3rd Floor, Mohakhali DOHS, Dhaka-1206
Contact: +8801712955908 E-mail: ocreedsbd@gmail.com

www.ocreeds.com



Date: 25-01-2020



O.CREEDS

ONUSONDHANI CREEDS

Field Survey Data Form

DWASA Surface Water Quality Monitoring Program

(1) **Sample location** : Bishondi (Bank of Meghna River), Arahaz.
 (Charotaranda, Bishnadi, Geo-Coordinates: N=23° 44' 47.107" N, E=90° 43' 00.000" E)
 (Distance: 105m from bank of river where SATP structure place is allocated)

(2) **Field Observations**:
 Upon arrival at a sampling site, record visual observations on the appearance of the water and other information related to water quality and water use as follows:

Parameter	Observation
a. Water Color	Greenish reddish / yellowish / muddy / colorless
b. Water appearance	Unusual amount of suspended matter / debris / foam / noise
c. Rain fall	Heavy / medium / low / none
d. Day	Cloudy day / very dry / very wet
e. Unusual Odors	Hydrogen sulfide odor / musty odor / sewage odor / none
f. Biological Activity	Excessive growth of algae / phytoplankton / others / none

(3) Water quality field test parameters (Weekly sample / Monthly sample)

Date: 25/01/2020 Time: 10 AM - 10 PM

Sample	Depth (m)	Temp (°C)	pH	Salinity (‰)	Cond. (µs/cm)	TDS (mg/l)	DO (mg/l)	Turbidity (NTU)	Hardness (mg/l)	NH ₄ (mg/l)	Color (PCU)	Flow (m ³ /s)
1 st grab sample	0.5	23	7.6	0.05	116.6	54.6	7.82	10.81	80	0.71	182	
2 nd grab sample	4	20.2	7.4	0.05	116.6	55.3	8.4	12.33	60	0.72	178	
3 rd grab sample	8	20.2	7.3	0.05	118.3	55.9	8.7	11.46	60	0.68	178	
Composite Sample (1 st +2 nd +3 rd Grab Sample)	20	7.3	0.05	117.8	55.7	8.61	10.26	60	0.70	177		


Note-1:
 Field test parameters (Weekly & Monthly): Temp=temperature; pH; Salinity; Cond=Conductivity; DO=Dissolved Oxygen; Turbidity; TDS=Total Dissolve Solid; Hardness; NH₄=Ammonia; Color

Note-2:
 Lab test parameters (Monthly sampling): Nitrate; Nitrite; COD; TSS; BOD; Phosphate; Alkalinity; Ammonia; Total Hardness; Arsenic; Iron; Manganese; Aluminium

House # 135, Road # 05, 3rd Floor, Mohakhali DOHS, Dhaka-1206
 Contact: +8801712955908 E-mail: ocreedsbd@gmail.com

www.ocreeds.com







O.CREEDS

ONUSONDHANI CREEDS

(4) Any other observations/comments:

River Water Depth: 16.4 m

 <hr/> <p style="margin: 0;">Water Quality/ Environmental Specialist</p> <p style="margin: 0;">Name: Md. Shahadat Hossain</p> <p style="margin: 0;">Date: 25/01/20</p>	 <hr/> <p style="margin: 0;">Water Quality Analyzer</p> <p style="margin: 0;">Name: Ishraqe Bin Khalil</p> <p style="margin: 0;">Date: 25/01/20</p>
---	---

DWASA PMU Representative

Name:

Designation:



Date:

House # 135, Road # 05, 3rd Floor, Mohakhali DOHS, Dhaka-1206
Contact: +8801712955908 E-mail: ocreedsbd@gmail.com

www.ocreeds.com



ANNEXURE-5: Lab test result scan copy (Monthly)

	Government of the People's Republic of Bangladesh Office of the Chief Chemist Department of Public Health Engineering Central Lab, 38-39, Mohakhali C/A, Dhaka-1212 Phone: 88-02-9891927, Fax: 88-02-9892003, Email: wqmc_central_lab@pshes.com	
---	---	---

Lab Memo: 694/CC, DPHE, CL, Dhaka.

Date: 05-02-2020

Physical /Chemical/ Bacteriological Analysis of Water Sample




Sample ID: CEN/20020009	Sample Receiving date: 27-01-2020
Ref. Memo No: O.Creeds/2020NI/ & Dated: 26-01-2020	Sample Source: River Water
Sent by: Engr. Md. Shahadat Hossain, Chief Executive Officer, O. Creeds, Mohakhali DOHS, Dhaka-1205.	Dist: Narayanganj, Upa-Araharar
Care Taker: O. Creeds (Sample : M-26 Jan 2020-DWASA)	Union, VII, Meghna river
Sample Collection date: 27-01-2020	Date of Testing: 27/01/2020-05/02/2020

LABORATORY TEST RESULTS:

Sl.#	Water quality parameters	Bangladesh Standard	Concentration present	Unit	Analysis Method	LOQ
1	Alkalinity	-	87	mg/L	Titrimetic	-
2	Aluminium (Al)	0.2	0.180	mg/L	AAS	0.002
3	Ammonia	0.5	0.62	mg/L	UVS	0.1
4	Arsenic (As)	0.05	0.001	mg/L	AAS	0.001
5	Biochemical Oxygen Demand (BOD)	0.2	2	mg/L	5 days incubation	0.1
6	Chemical Oxygen Demand (COD)	4.0	4	mg/L	CRM	-
7	Hardness	200-500	60	mg/L	Titrimetic	-
8	Iron (Fe)	0.3-1	0.30	mg/L	AAS	0.05
9	Manganese (Mn)	0.1	0.03	mg/L	AAS	0.03
10	Nitrogen (Nitrate)	10.0	2.1	mg/L	UVS	0.10
11	Nitrogen (Nitrite)	<1.0	0.03	mg/L	UVS	0.02
12	Phosphate	6.0	0.45	mg/L	UVS	0.10
13	Total Suspended Solid (TSS)	10	2	mg/L	Gravimetric Method	-

Comments: Sample was collected & Supplied by client.

N.B: AAS - Atomic Absorption Spectrophotometer, UVS- UV-Visible Spectrophotometer, CRM-Closed Reflex Methods, LOQ-Limit of Quantitation.

Test Performed by: 1.) Name: Md. Saiful Alam Khosru Designation: Sample Analyzer  05.02.2020 2.) Name: Taslima Akhter Designation: Sample Analyzer  05.02.2020	Countersigned/Approved by: 1.) Name: Mita Sarker Designation: Senior Chemist --- 2.) Name: Md. Biplob Hossain Designation: Chief Chemist  05/02/2020 Md. Biplob Hossain Chief Chemist Department of Public Health Engineering Central Laboratory, Mohakhali, Dhaka Page 1 of 1
---	--



ANNEXURE-6: **Previous Month Results**



Table W-1: Weekly Sampling Results; 18/07/2019

Weekly sampling: Water quality field test parameters results; Month: July/2019											
Date: 18-07-2019						Time: 10-12					
Sample	Depth (m)	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample	0.5	30.6	7.2	0.03	75.8	32.9	6.5	14.66	40	0.23	138
2nd grab sample	4	30.3	7.3	0.03	69.2	29.4	6.61	19.08	60	0.32	110
3rd grab sample	8	30.1	7.2	0.03	68.9	32	6.87	14.28	60	0.3	140
Composite sample (1st, 2nd, 3rd grab sample)	-	30.1	7.2	0.03	66	30.9	6.8	16.32	40	0.2	122
Max		30.6	7.3	0.03	75.8	32.9	6.87	19.08	60	0.32	140
Min		30.1	7.2	0.03	66	29.4	6.5	14.28	40	0.2	110
Avg.		30.3	7.23	0.03	70.28	31.25	6.69	16.28	50	0.26	126.67

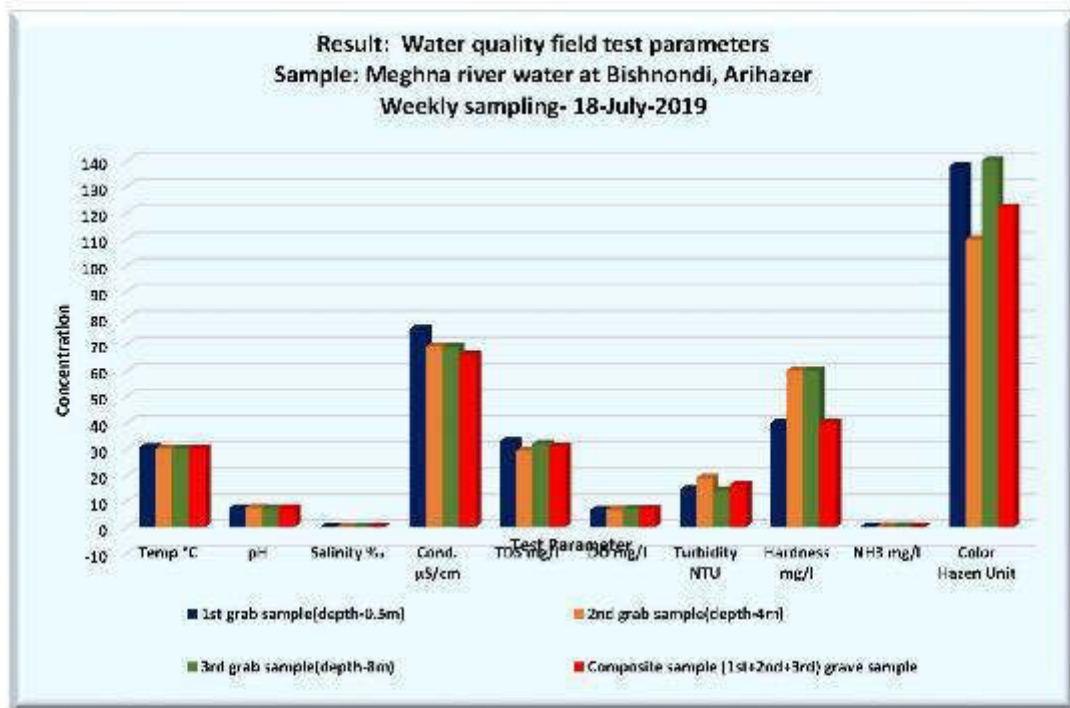


Figure A.1 Weekly Sampling Results; 18/07/2019



Table W-2: Weekly sampling results; 25/07/2019

Weekly sampling: Water quality field test parameters results; Month: July/2019											
Date: 25-07-2019						Time: 10-12					
Sample	Depth (m)	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample	0.5	30.3	7.5	0.03	75.9	32.4	6.39	12.1	60	0.24	139
2nd grab sample	4	30.4	7.4	0.03	78.9	33.4	6.66	19.48	40	0.33	140
3rd grab sample	8	30.5	7.2	0.03	82	34.2	6.79	14.28	60	0.36	145
Composite sample (1st+2nd+3rd) grab sample	-	30	7.2	0.03	78	31	6.8	17.89	40	0.21	145
Max		30.5	7.5	0.03	82	34.2	6.8	19.48	60	0.36	145
Min		30	7.2	0.03	75.9	31	6.39	12.1	40	0.21	139
Avg.		30.28	7.33	0.03	78.78	32.7	6.64	15.89	50	0.29	142.17

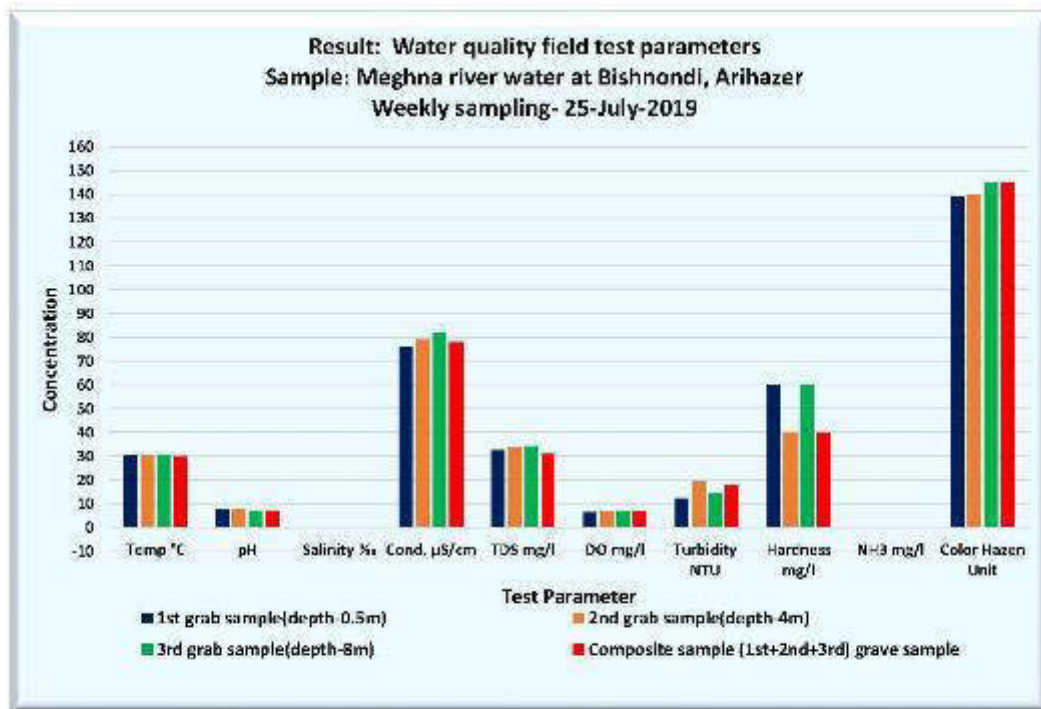


Figure A.2 Weekly sampling results; 25/07/2019



Table W-3: Weekly sampling results; Month: 31/July/2019

Water quality field test parameters (weekly sample); Month: July/2019											
Date: 31-07-2019						Time: 10-12					
Sample	Depth (m)	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample	0.5	30.1	7.6	0.03	65.5	32.8	6.35	19.2	40	0.32	147
2nd grab sample	4	30.1	7.4	0.03	68.4	34.25	6.63	19.4	40	0.33	152
3rd grab sample	8	30.1	7.2	0.03	68.9	37.7	6.7	19.85	40	0.35	160
Composite sample (1st+2nd+3rd grab sample)	-	30.3	7.1	0.03	65.2	32.7	6.41	19.32	40	0.33	157
	Max	30.3	7.6	0.03	68.9	37.7	6.7	19.85	40	0.35	160
	Min	30.1	7.1	0.03	65.2	32.7	6.35	19.2	40	0.32	147
	Avg	30.17	7.3	0.03	67.02	34.64	6.52	19.47	40	0.33	153.83

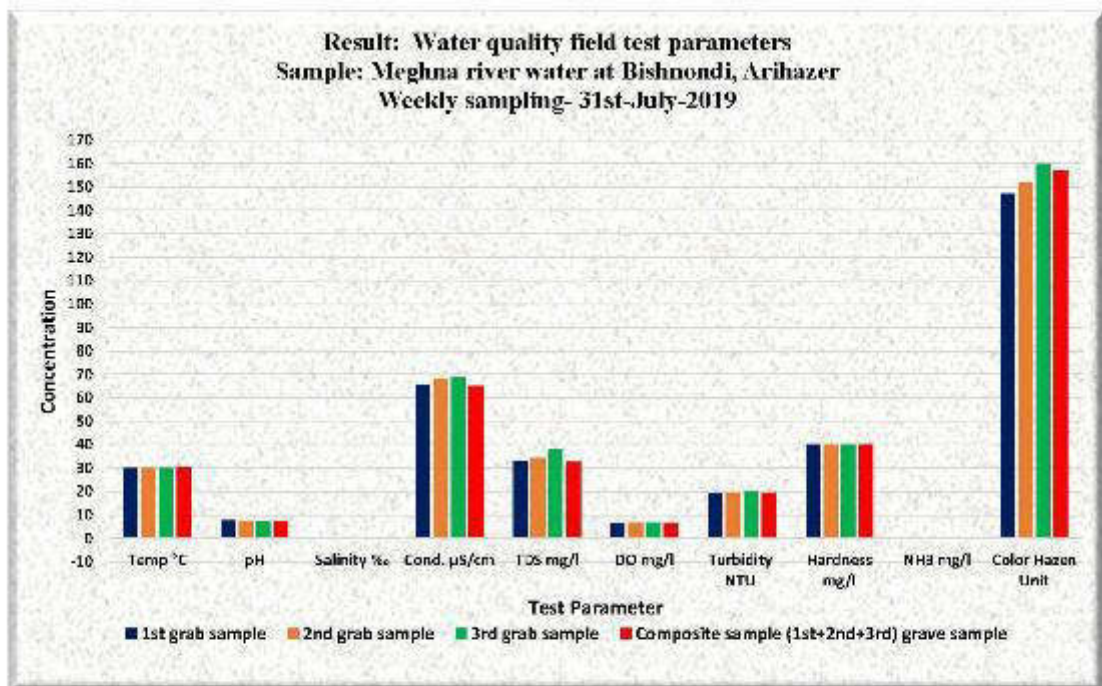


Figure A.3 Weekly sampling results; 31/07/2019



Month: August/2019

Table W-4: Weekly sampling results; Month: 1/August/2019

Water quality field test parameters (weekly sample-1 st week); Month: August/2019										
Date: 01- 08-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	30.5	7.5	0.03	79.5	33.7	6.36	14.9	40	0.23	139
2nd grab sample (4m depth)	30.4	7.2	0.03	75.2	31.8	6.51	17.04	40	0.27	142
3rd grab sample (8m depth)	30.5	7.2	0.03	75.8	31.9	6.79	16.86	40	0.3	145
Composite sample (1st+2nd+3rd grab sample)	30.3	7.2	0.03	78	33	6.77	12.13	40	0.24	140
Max	30.5	7.5	0.03	79.5	33.7	6.79	17.04	40	0.3	145
Min	30.3	7.2	0.03	75.2	31.8	6.36	12.13	40	0.23	139
Avg.	30.41667	7.30	0.03	77.20	32.65	6.60	15.02	40	0.26	141.67

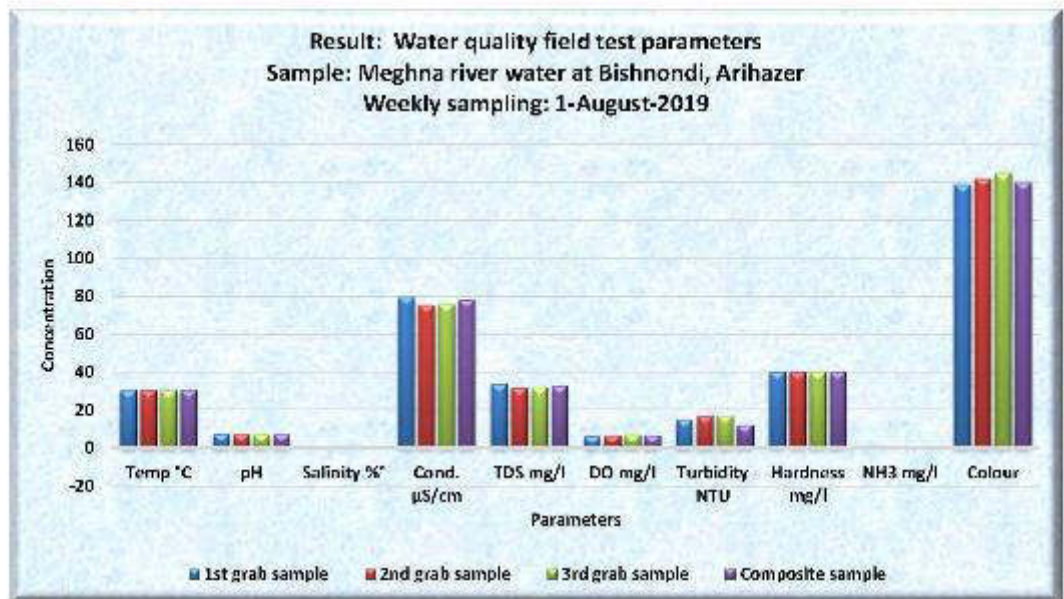


Figure A.4 Weekly sampling results; 01/08/2019



Table W-5: Weekly sampling results; Month: 8/August/2019

Water quality field test parameters (weekly sample-2 nd week); Month: August/2019										
Date:08- 08-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	30.6	7.5	0.03	74.5	35.6	6.3	12.4	40	0.24	139
2nd grab sample (4m depth)	30.5	7.3	0.03	72.3	30.5	6.86	18.43	40	0.27	146
3rd grab sample (8m depth)	30.4	7.1	0.03	76.3	32.2	6.91	17.64	60	0.31	116
Composite sample (1st+2nd+3rd grab sample)	30.3	7.3	0.03	83	34.8	6.86	17.69	40	0.21	127
Max	30.6	7.5	0.03	83	35.6	6.91	18.43	60	0.31	146
Min	30.3	7.1	0.03	72.3	30.5	6.3	12.4	40	0.21	116
Avg.	30.45	7.30	0.03	76.90	33.2	6.69	16.17	46.66	0.26	131.67

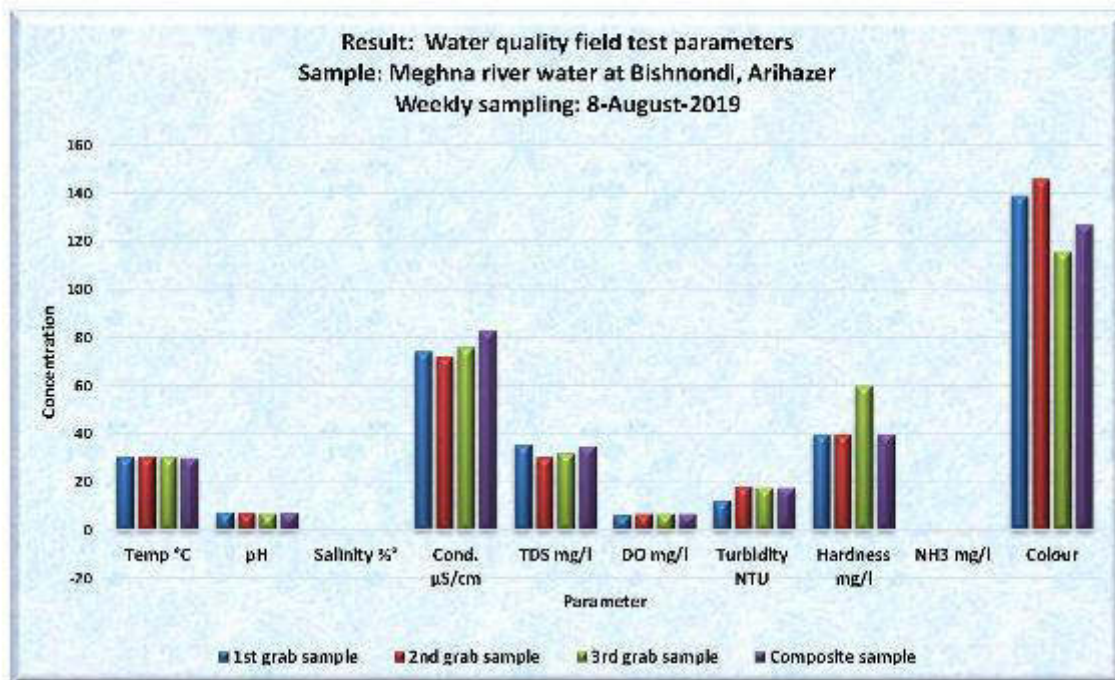


Figure A.5 Weekly sampling results; 08/08/2019



Table W-6: Weekly sampling results; Month: 14/August/2019

Water quality field test parameters (weekly sample 3 rd week); Month: August/2019										
Date: 14-08-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	30.5	7.5	0.03	64.2	30.25	6.4	19.4	40	0.33	151
2nd grab sample (4m depth)	30.4	7.5	0.03	67.4	33.2	6.32	18.89	40	0.29	180
3rd grab sample (8m depth)	30.1	7.3	0.03	68.5	32	6.09	18.5	40	0.32	144
Composite sample (1st+2nd+3rd grab sample)	30	7.3	0.03	66.1	30.1	6.78	17.7	40	0.25	170
Max	30.5	7.5	0.03	68.5	33.2	6.78	19.4	40	0.33	180
Min	30	7.3	0.03	64.2	30.1	6.32	17.7	40	0.25	144
Avg.	30.25	7.40	0.03	66.48	31.475	6.55	18.60	40	0.30	161.50

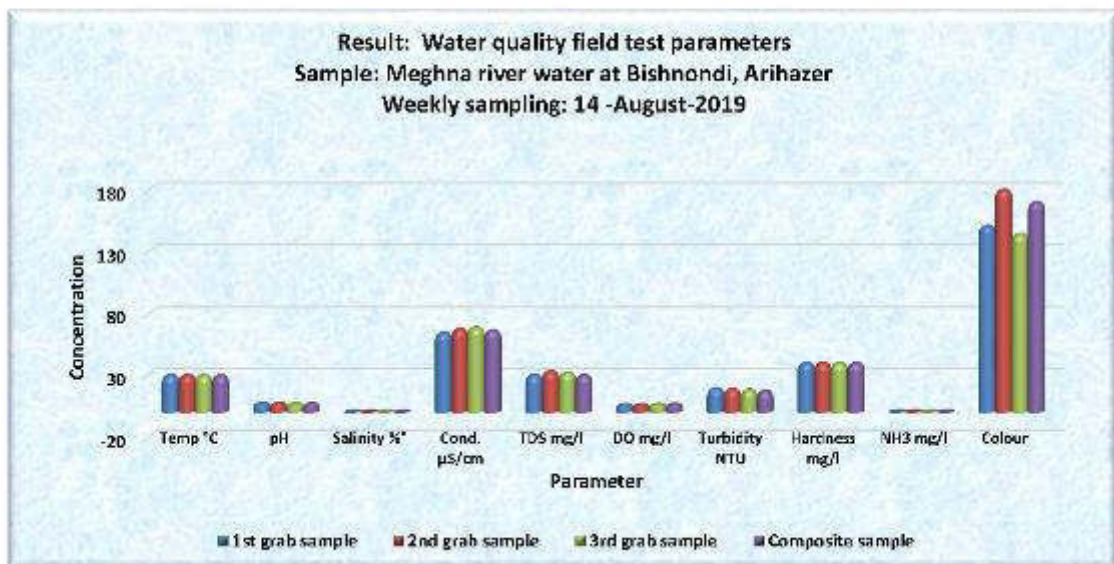


Figure A.6 Weekly sampling results; 14/08/2019



Table W-7: Weekly sampling results; Month: 21/August/2019

Water quality field test parameters (weekly sample-4 th week); Month: August/2019										
Date: 21-08-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	33.3	7.1	0.03	73.7	29.8	6.02	23.26	40	0.33	142
2nd grab sample (4m depth)	34.4	7.2	0.03	72.8	28.6	6.19	21.49	40	0.3	177
3rd grab sample (8m depth)	33.9	7.1	0.03	72.7	29	6.2	19.76	40	0.35	181
Composite sample (1st+2nd+3rd grab sample)	33.5	7.1	0.03	77.9	31.2	6.2	22.04	40	0.24	181
Max	34.4	7.2	0.03	77.9	31.2	6.2	23.26	40	0.35	181
Min	33.3	7.1	0.03	72.7	28.6	6.02	19.76	40	0.24	142
Avg.	33.76	7.13	0.03	74.62	29.73	6.14	21.60	40	0.30	167.33

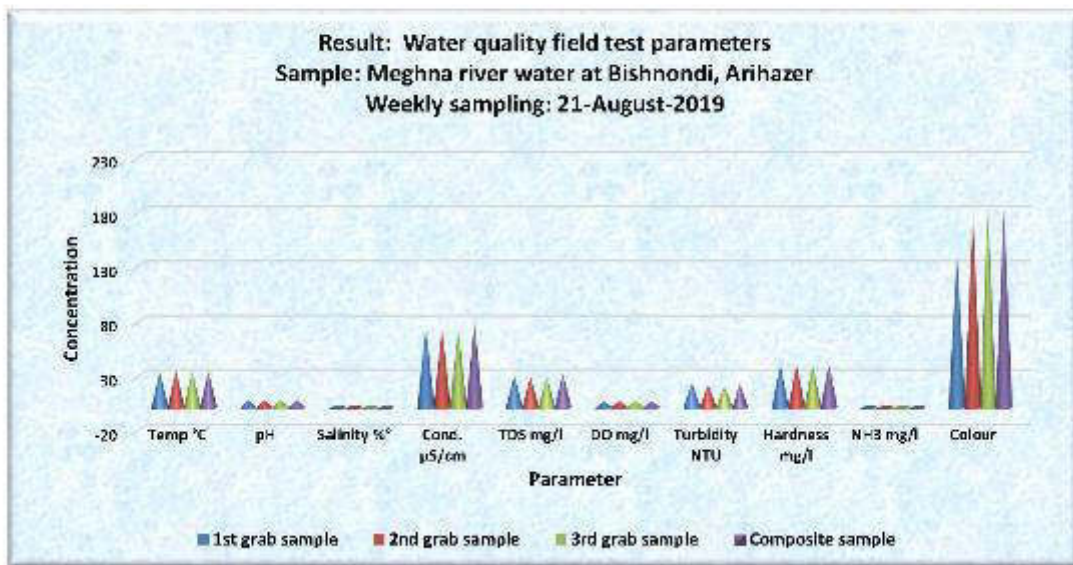


Figure A.7 Weekly sampling results; 21/08/2019

**Data of Fifth weekly sample (28/8/2019) = Date of seasonal sample in the same date



Laboratory Test- Monthly sample and Seasonal Sample

Laboratory Test Results- Monthly Sample

Water quality Laboratory test result- Monthly sample; Composite sample					
Test conducted by: DPHE Central Laboratory, Mohakhali, Dhaka					
1st- Monthly sample: August/2019					
Date: 31-08-2019		Composite sample Depth-[Sample-1: 0.5m+Sample-2:4m+Sample-3: 8m]			
Water quality parameters	Bangladesh Standard	Concentration present	Unit	Analysis Method	LOQ
Alkalinity		38	mg/l	Titrimetric	
Aluminum	0.2	0.23	mg/l	AAS	0.002
Ammonia	0.5	0.63	mg/L	UVS	0.1
Arsenic (As)	0.05	0.001	mg/l	AAS	0.001
Biochemical Oxygen Demand (BOD)	0.2	18	mg/L	days Incubation	0.1
Chemical Oxygen Demand (COD)	4	68	mg/l	CRM	
Hardness	200-500	110	mg/L	Titrimetric	
Iron (Fe)	0.3-1	0.49	mg/L	AAS	0.05
Manganese (Mn)	0.1	0.1	mg/l	AAS	0.05
Nitrogen (Nitrite)	10	2.5	mg/L	UVS	0.1
Nitrogen (Nitrate)	<1.0	0.05	mg/l	UVS	0.02
Phosphate	6	0.73	mg/l	UVS	0.1
Total Suspended Solid (TSS)	10	4.3	mg/L	Gravimetric Method	



Laboratory Test Results - Seasonal Sample

Water quality Laboratory test result- Seasonal sample; Composite sample					
Test conducted by: DPHE Central Laboratory, Mohakhali, Dhaka					
1st seasonal sample: August/2019					
Date: 31-08-2019		Composite sample Depth=[Sample-1: 0.5m-Sample-2:4m+Sample-3: 8m]			
Water quality parameters	Bangladesh Standard	Concentration present	Unit	Analysis Method	LOQ
Ammonia	0.5	0.6	mg/L	UVS	0.1
Arsenic (As)	0.05	0.001	mg/L	AAS	0.01
Barium (Ba)	0.01	0.09	mg/L	AAS	-
Biochemical Oxygen Demand (BOD)	0.2	8	mg/L	5 days Incubation	0.1
Cadmium (Cd)	0.005	0.00058	mg/L	AAS	0.00015
Chemical Oxygen Demand (COD)	4	36	mg/L	CRM	-
Chloride	150-600	10	mg/L	Titrimetric	-
Coliform (Focal)	0	144	N/100ml	MPM	-
Copper (Cu)	1	0.26	mg/L	AAS	0.26
Chromium (Total)[Cr]	0.05	0.008	mg/L	AAS	0.0003
Fluoride	1	0.12	mg/L	UVS	0.12
Lead (Pb)	0.05	0.004	mg/L	AAS	0.001
Nickel (Ni)	0.1	0.03	mg/L	AAS	0.01
Nitrogen (Nitrate)	10	1.9	mg/L	UVS	0.1
Nitrogen (Nitrite)	<1.0	0.03	mg/L	UVS	0.02
Phosphate	6	0.84	mg/L	UVS	0.1
Selenium (Se)	0.01	0.001	mg/L	AAS	0.002
Sodium (Na)	200	10	mg/L	AAS	0.34
Sulphate	400	1	mg/L	UVS	1
Zinc (Zn)	5	0.08	mg/L	AAS	0.05



Month: September/2019

Table W-8: Weekly sampling results; Month: 5/September/2019

Water quality field test parameters (weekly sample- 1 st week); Month: September/2019										
Date:05- 09-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	32	7.5	0.03	71.4	29.3	6.67	17.04	40	0.23	49
2nd grab sample (4m depth)	31.6	7.6	0.03	74.3	30.7	6.68	13.81	40	0.28	51
3rd grab sample (8m depth)	31.6	7.3	0.03	73.3	30.3	6.79	15.12	40	0.21	56
Composite sample (1st+2nd+3rd grab sample)	31.4	7.4	0.03	71	29.8	6.94	12.68	40	0.28	62
Max	30.1	7.8	0.03	73	31.3	7.08	23.56	40	0.33	142
Min	29.3	7.5	0.03	58.3	27.4	7.01	17.62	40	0.24	125
Avg.	29.74	7.66	0.03	65.56	29.02	7.04	20.548	40	0.288	132.8

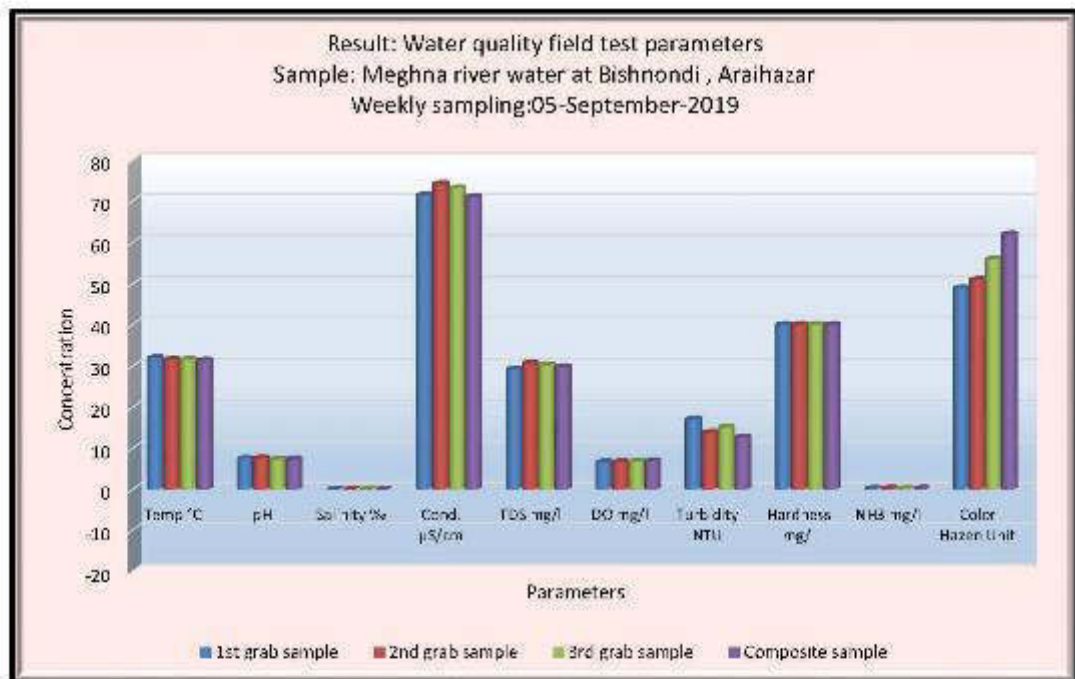


Figure A.8 Weekly sampling results; 05/09/2019



Table W-9: Weekly sampling results; Month: 14/September/2019

Water quality field test parameters (weekly sample-2 nd week); Month: September/2019										
Date:14- 09-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	32	7.6	0.03	70.6	34.2	7.12	36.91	40	0.19	213
2nd grab sample (4m depth)	31.6	7.6	0.03	69.7	32.7	7.32	33.7	40	0.2	232
3rd grab sample (8m depth)	31.6	7.5	0.03	87.6	41.6	7.34	28.58	40	0.2	222
Composite sample (1st+2nd+3rd grab sample)	31.4	7.5	0.03	78.3	37.2	7.34	28.99	40	0.22	228
Max	32	7.6	0.03	87.6	41.6	7.34	36.91	40	0.2	232
Min	31.6	7.5	0.03	69.7	32.7	7.12	28.58	40	0.19	213
Avg.	31.76	7.56	0.03	77.04	36.56	7.248	32.936	40	0.196	222.4

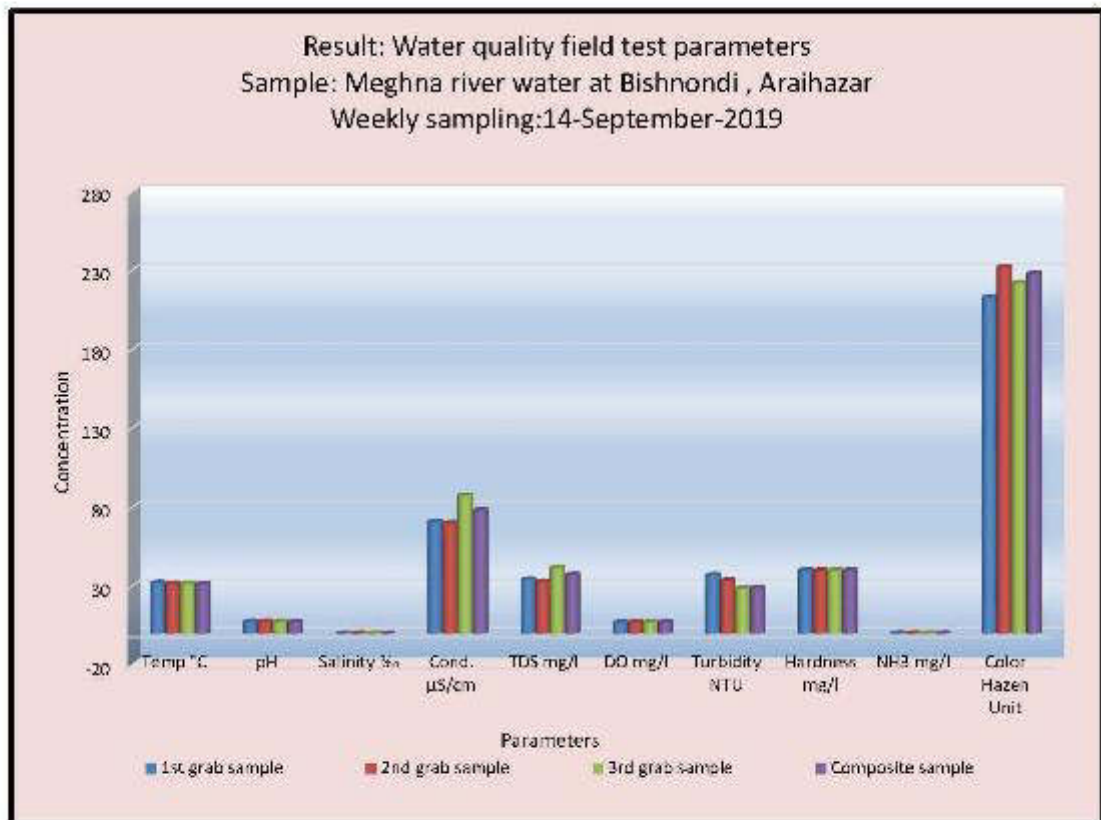


Figure A.9 Weekly sampling results; 14/09/2019



Table W-10: Weekly sampling results; Month: 21/September/2019

Water quality field test parameters (weekly sample-3 rd week); Month: September/2019										
Date: 21-09-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	32.7	7.4	0.03	74.2	30	6.4	16.25	40	0.3	86
2nd grab sample (4m depth)	32.4	7.6	0.03	69.4	28.2	6.76	24.27	40	0.3	88
3rd grab sample (8m depth)	32.3	7.5	0.03	71.9	29.3	6.67	20.24	40	0.28	118
Composite sample (1st+2nd+3rd grab sample)	31.7	7.4	0.03	73.3	30.2	6.77	23.32	40	0.28	92
Max	32.7	7.6	0.03	74.2	30	6.76	24.27	40	0.3	118
Min	32.3	7.4	0.03	69.4	28.2	6.4	16.25	40	0.28	86
Avg.	32.48	7.5	0.03	71.82	29.14	6.598	20.256	40	0.292	99.2

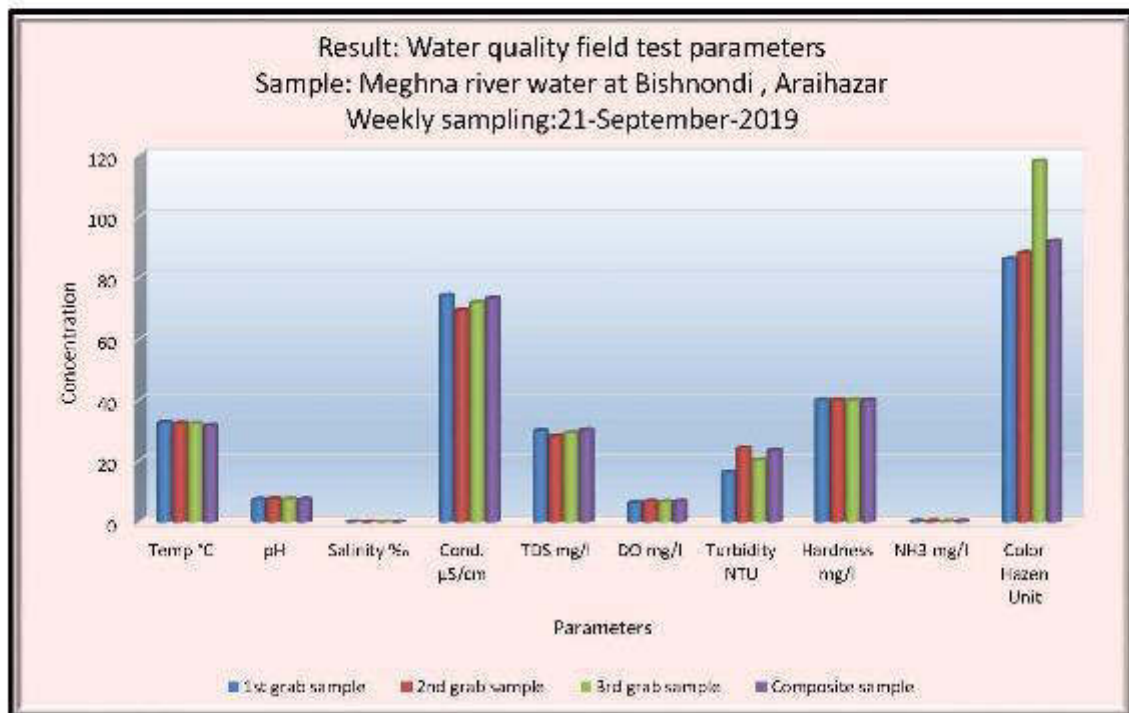


Figure A.10 Weekly sampling results; 21/09/2019



Table W-11: Weekly sampling results; Month: 28/September/2019

Water quality field test parameters (weekly sample-4 th week); Month: September/2019										
Date:28- 09-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity % ^o	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	30.1	7.7	0.03	65.2	27.7	7.01	17.62	40	0.33	142
2nd grab sample (4m depth)	29.9	7.8	0.03	73	31.3	7.02	20.38	40	0.3	130
3rd grab sample (8m depth)	29.3	7.5	0.03	58.3	27.4	7.08	23.56	40	0.24	125
Composite sample (1st+2nd+3rd grab sample)	29.6	7.5	0.03	68.4	30	7.28	20.61	40	0.28	133
Max	30.1	7.8	0.03	73	31.3	7.08	23.56	40	0.33	142
Min	29.3	7.5	0.03	58.3	27.4	7.01	17.62	40	0.24	125
Avg.	29.74	7.66	0.03	65.56	29.02	7.04	20.548	40	0.288	132.8

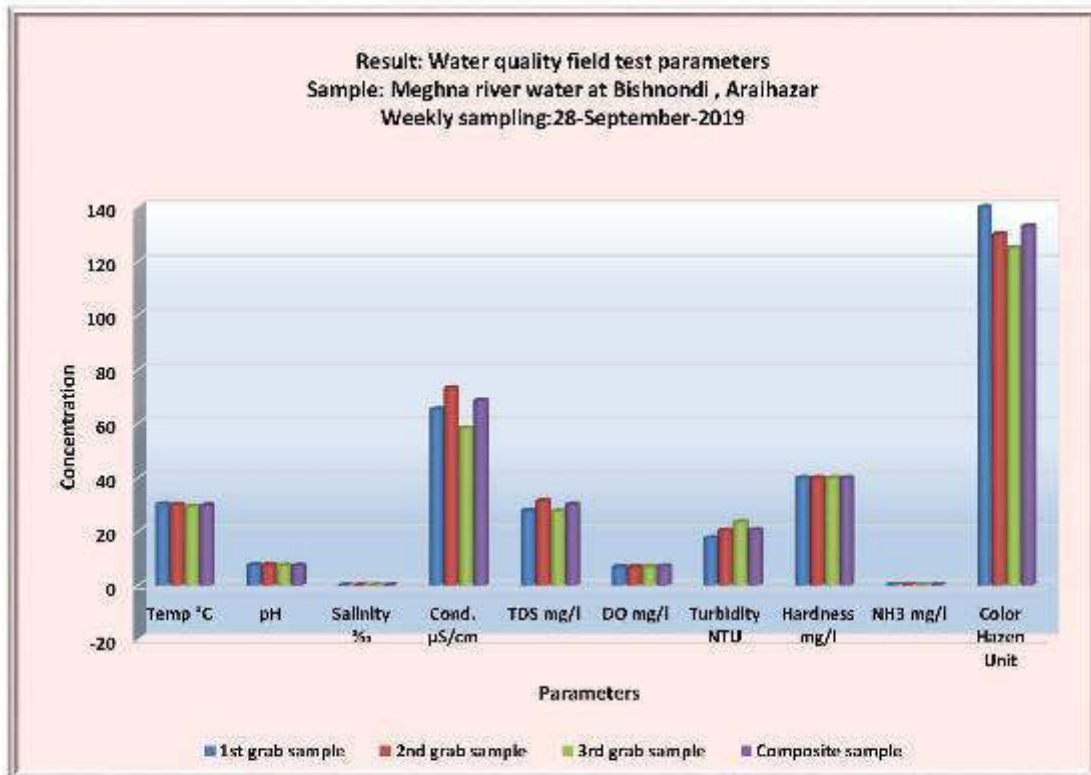


Figure A.11 Weekly sampling results; 28/09/2019



Month: October/2019

Table W-12: Weekly sampling results; Month: 12/October/2019

Water quality field test parameters (weekly sample 1 st week); Month: October/2019										
Date: 5-10-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	30.5	8.2	0.03	87.5	38.1	6.67	22.04	40	0.5	125
2nd grab sample (4m depth)	29.9	7.9	0.03	71	30.3	7.04	24.8	40	0.5	128
3rd grab sample (8m depth)	29.8	7.6	0.03	71.1	30.4	7.23	21.8	40	0.5	121
Composite sample (1st+2nd+3rd grab sample)	30.3	7.4	0.03	70.7	32.5	7.22	20.15	40	0.5	123
Max	30.5	8.2	0.03	87.5	38.1	7.23	24.8	40	0.5	128
Min	29.8	7.6	0.03	71	30.3	6.67	21.8	40	0.5	121
Avg.	30.1	7.9	0.03	77.62	33.44	6.968	23.048	40	0.5	124.6

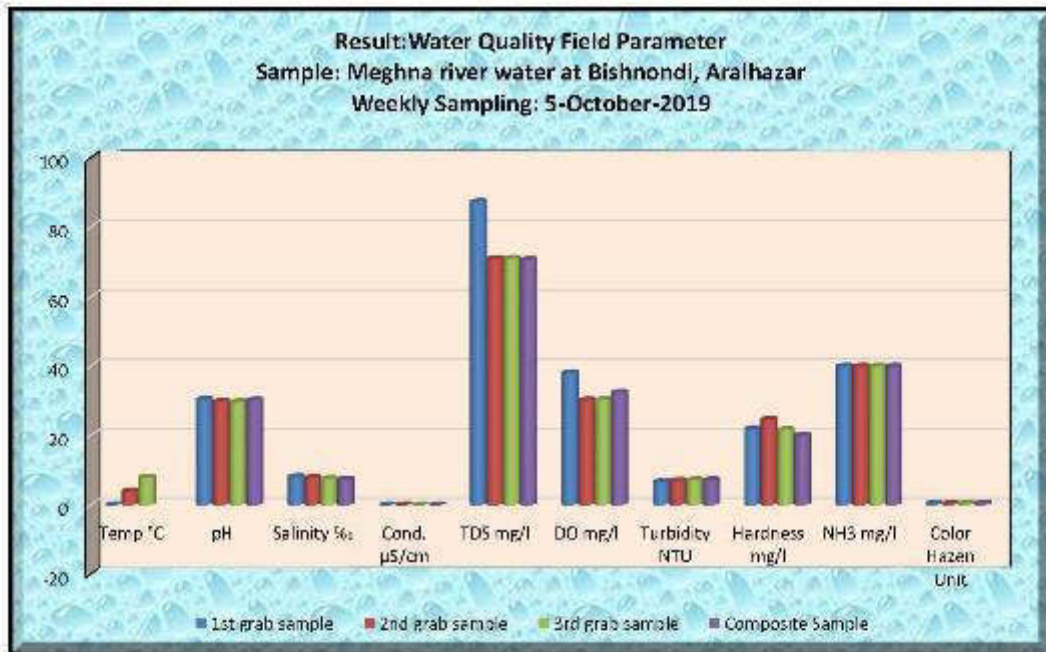


Figure A.12 Weekly sampling results; 05/10/2019



Table W-13: Weekly sampling results; Month: 12/October/2019

Water quality field test parameters (weekly sample-2 nd week), Month: October/2019										
Date: 12-10-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	31.5	7.7	0.03	77.7	32.2	6.57	18.82	40	0.5	128
2nd grab sample (4m depth)	30.4	7.9	0.03	73.6	31.1	6.67	19.68	40	0.5	129
3rd grab sample (8m depth)	30.1	7.8	0.03	71.2	30.3	6.69	22.85	40	0.5	119
Composite sample (1st+2nd+3rd grab sample)	30.2	7.6	0.03	73.7	31.3	6.83	18.44	40	0.5	121
Max	31.5	7.9	0.03	77.7	32.2	6.69	22.85	40	0.5	129
Min	30.1	7.7	0.03	71.2	30.3	6.57	18.82	40	0.5	119
Avg.	30.72	7.8	0.03	74.28	31.22	6.638	20.604	40	0.5	124.8

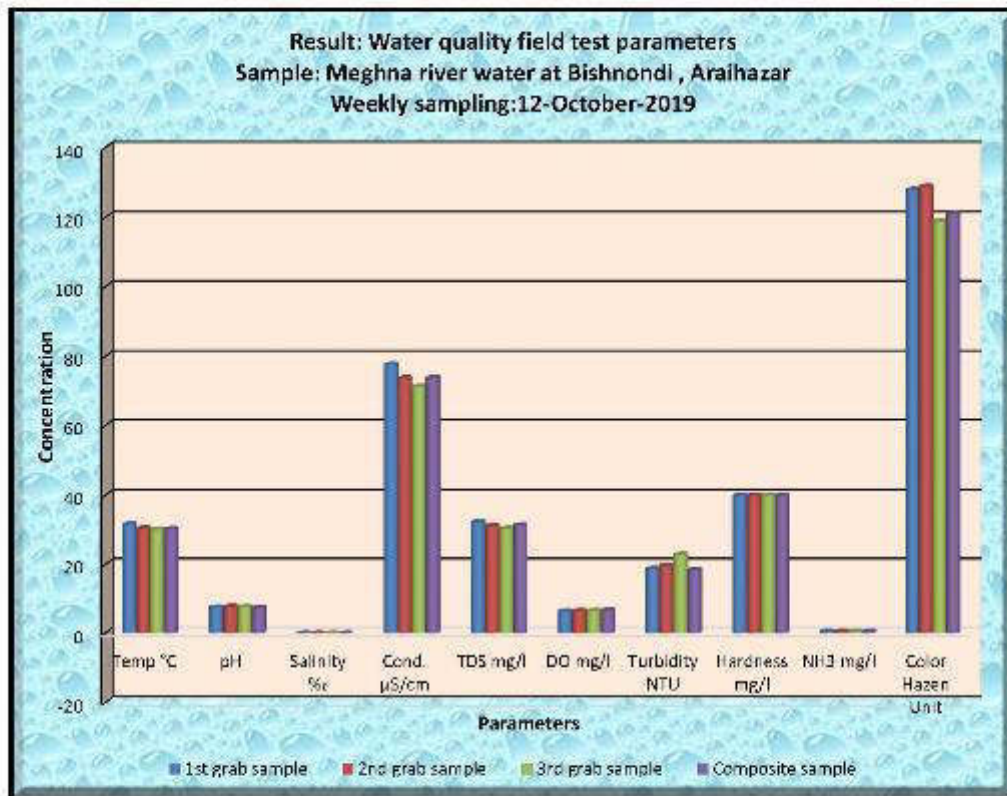


Figure A.13 Weekly sampling results; 12/10/2019



Table W-14: Weekly sampling results; Month: 19/October/2019

Water quality field test parameters (weekly sample-3 rd week); Month: October/2019										
Date:19- 10-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	32.6	7.5	0.03	72.2	29.3	6.54	23.61	40	0.518	114
2nd grab sample (4m depth)	30.9	7.7	0.03	73	30.6	6.67	23.82	40	0.523	104
3rd grab sample (8m depth)	30.3	7.3	0.03	73.7	31.1	7.08	24.12	40	0.517	98
Composite sample (1st+2nd+3rd grab sample)	30.8	7.5	0.03	72.6	32.6	6.89	22.28	40	0.519	101
Max	32.6	7.7	0.03	73.7	31.1	7.08	24.12	40	0.523	114
Min	30.3	7.3	0.03	72.2	29.3	6.54	23.61	40	0.517	98
Avg.	31.34	7.5	0.03	72.96	30.28	6.782	23.856	40	0.5196	105.6

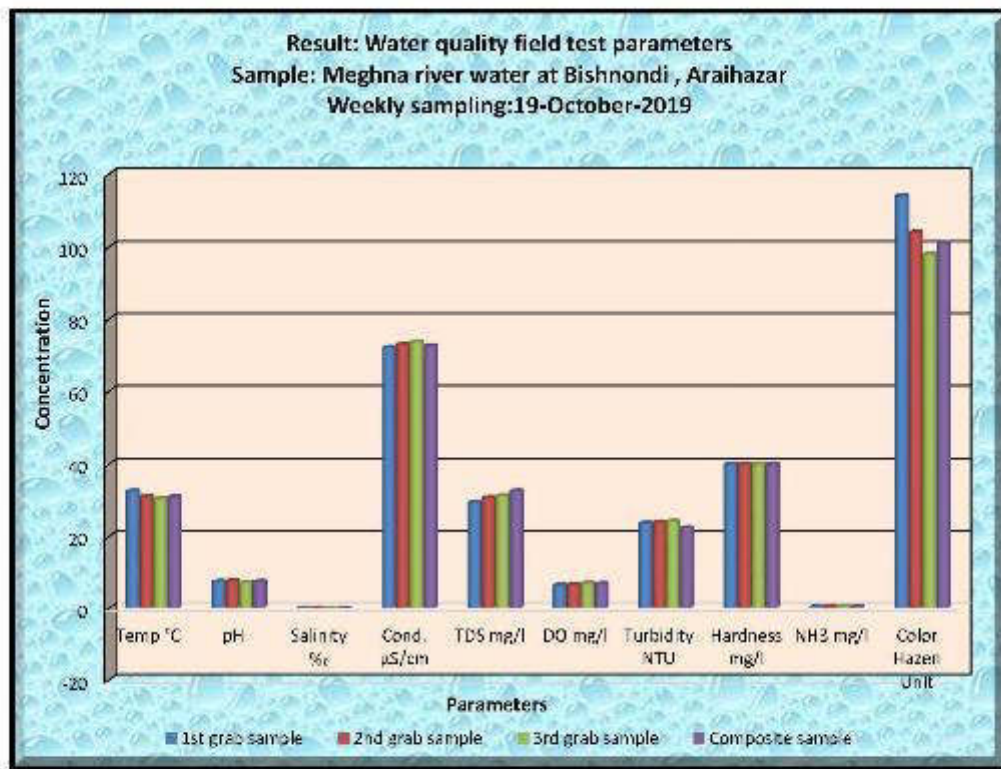


Figure A.14 Weekly sampling results; 19/10/2019



Table W-15: Weekly sampling results; Month: 26/October/2019

Water quality field test parameters (weekly sample-4 th week); Month: October/2019										
Date:26- 10-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	28.4	7.7	0.03	74	32.5	7.05	25.5	40	0.31	151
2nd grab sample (4m depth)	28.3	7.8	0.03	73.8	32.5	6.76	26.9	40	0.33	143
3rd grab sample (8m depth)	28.3	7.2	0.03	73.6	32.4	7.15	30.59	40	0.29	132
Composite sample (1st+2nd+3rd grab sample)	28.1	7.2	0.03	73.4	32.4	7.24	26.65	40	0.32	140
Max	28.4	7.8	0.03	74	32.5	7.15	30.59	40	0.33	151
Min	28.3	7.2	0.03	73.6	32.4	6.76	25.5	40	0.29	132
Avg.	28.34	7.54	0.03	73.8	32.46	6.974	27.816	40	0.31	141.8

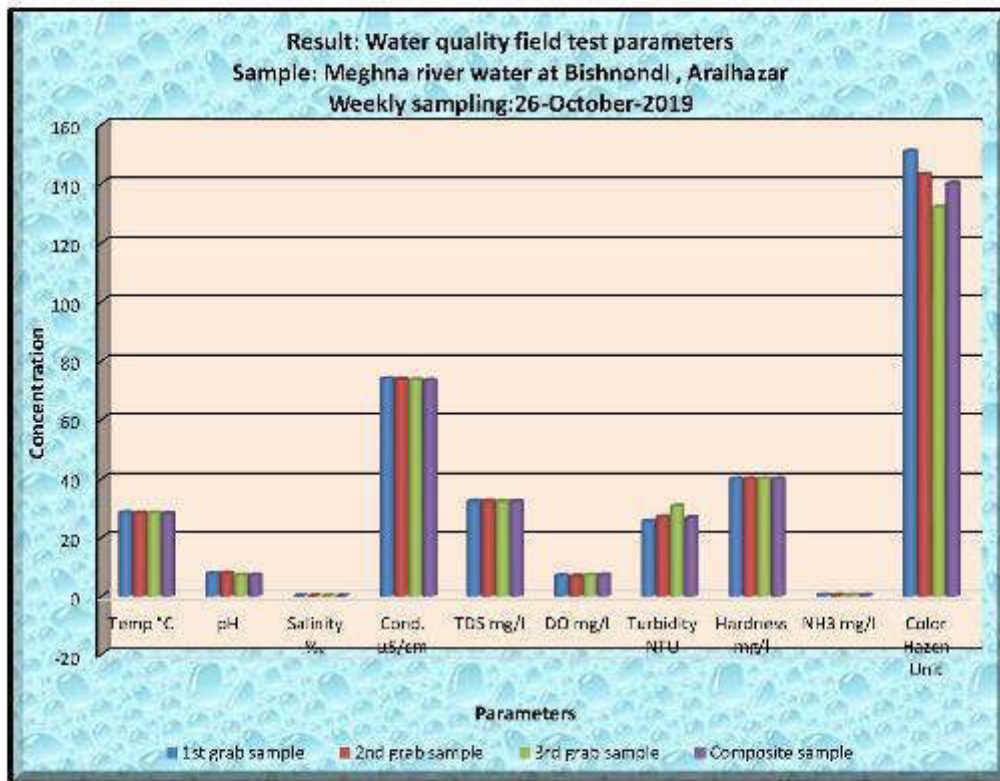


Figure A.15 Weekly sampling results; 26/10/2019



Month: November/2019

Table W-16: Weekly sampling results; Month: 02/November/2019

Water quality field test parameters (weekly sample-1 st week); Month: November/2019										
Date:02- 11-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	30.3	7.3	0.03	74.6	32	6.52	70	40	0.33	325
2nd grab sample (4m depth)	28.3	7.3	0.03	74.3	32.8	6.83	72	40	0.35	326
3rd grab sample (8m depth)	28.2	7.2	0.03	79.4	35	6.79	65	40	0.33	315
Composite sample (1st+2nd+3rd grab sample)	28	7.2	0.03	77.1	33.9	6.84	70	40	0.33	321
Max	30.3	7.3	0.03	79.4	35	6.83	72	40	0.35	326
Min	28.2	7.2	0.03	74.3	32	6.52	65	40	0.33	315
Avg.	28.933	7.2667	0.03	76.1	33.2667	6.7133	69	40	0.33667	322

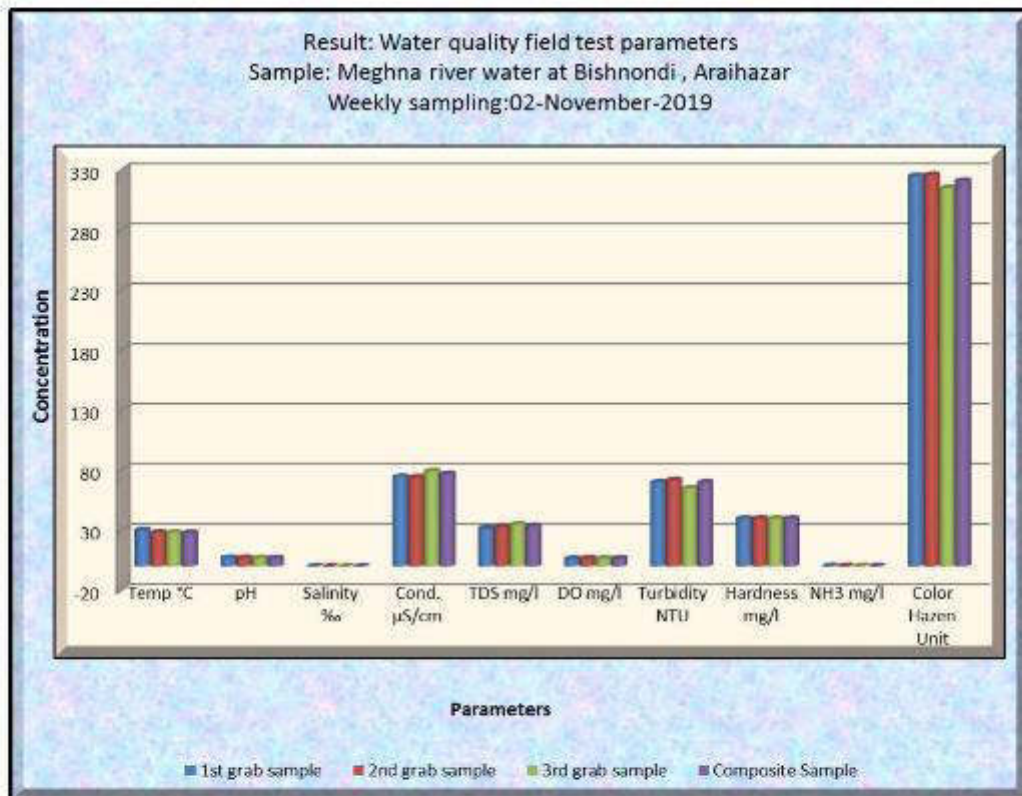


Figure A.16 Weekly sampling results; 02/11/2019



Table W-17: Weekly sampling results; Month: 11/November/2019

Water quality field test parameters (weekly sample 2 nd week); Month: November/2019										
Date: 11- 11-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity % ^o	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	27.7	7.4	0.03	80.8	37.3	7.08	32.26	40	0.3	213
2nd grab sample (4m depth)	27.1	7.5	0.03	83.8	31.5	7.01	31.32	40	0.55	197
3rd grab sample (8m depth)	26.8	7.3	0.03	74.8	31.2	7.12	32.2	40	0.36	182
Composite sample (1st+2nd+3rd grab sample)	27.2	7.4	0.03	77.4	32.4	7.09	30.96	40	0.4	189
Max	27.7	7.5	0.03	83.8	37.3	7.12	32.26	40	0.55	213
Min	26.8	7.3	0.03	74.8	31.2	7.01	31.32	40	0.3	182
Avg.	27.2	7.4	0.03	79.8	33.3333	7.07	31.92667	40	0.40333	197.333333

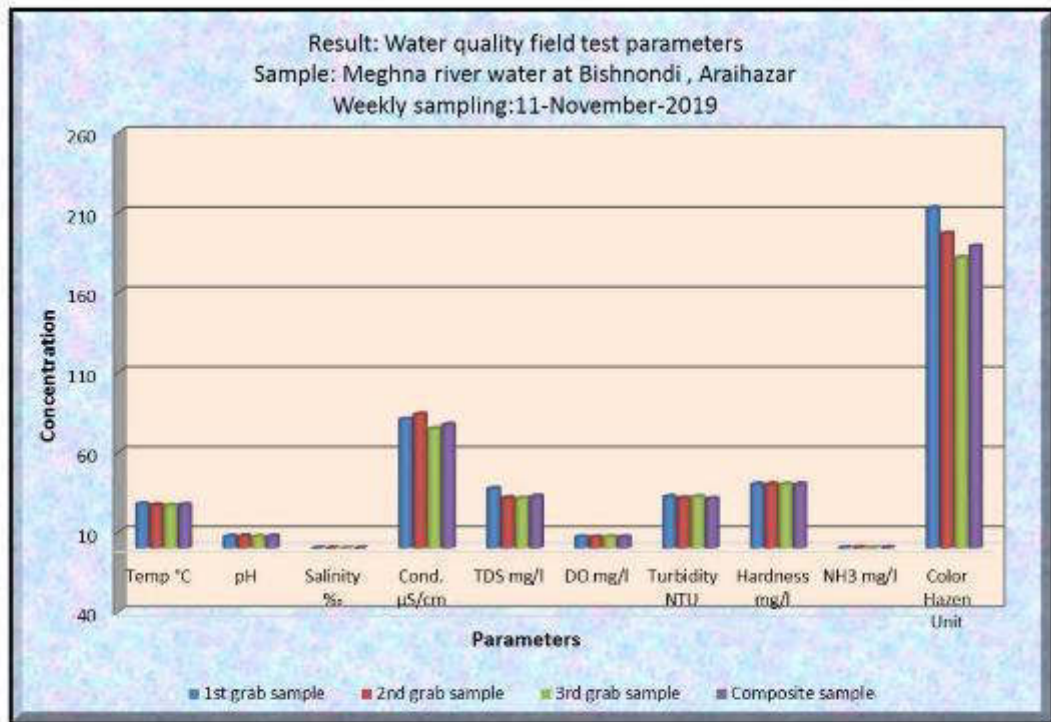


Figure A.17 Weekly sampling results; 11/11/2019



Table W-18: Weekly sampling results; Month: 16/November/2019

Water quality field test parameters (weekly sample-3 rd week); Month: November/2019										
Date:16- 11-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	28.2	7.5	0.03	76.1	34.3	7.02	26.25	40	0.33	211
2nd grab sample (4m depth)	27	7.6	0.03	77.3	36.1	6.98	28.32	40	0.51	215
3rd grab sample (8m depth)	26.6	7.3	0.03	76.5	34.9	7.09	29.25	40	0.48	205
Composite sample (1st+2nd+3rd grab sample)	27.2	7.5	0.03	76.9	34.9	7.02	28.25	40	0.49	204
Max	28.2	7.6	0.03	77.3	36.1	7.09	29.25	40	0.51	215
Min	26.6	7.3	0.03	76.1	34.3	6.98	26.25	40	0.33	205
Avg.	27.27	7.47	0.03	76.83	35.1	7.03	27.94	40	0.44	210.33

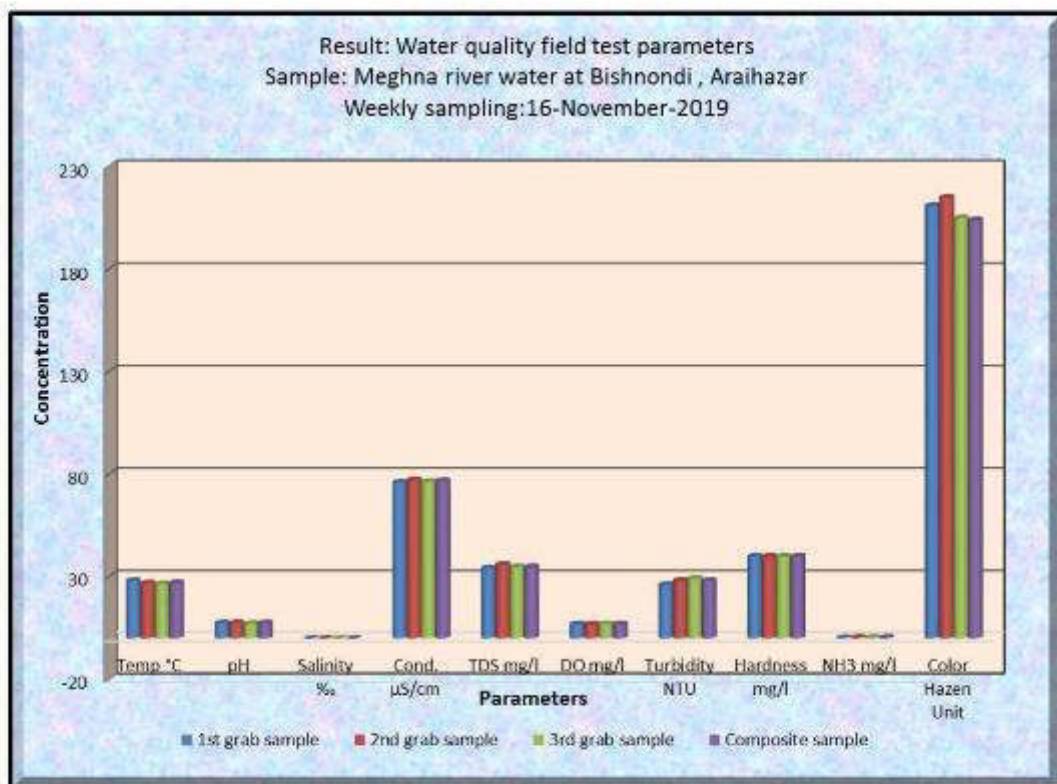


Figure A.18 Weekly sampling results; 16/11/2019



Table W-19: Weekly sampling results; Month: 23/November/2019

Water quality field test parameters (weekly sample-4 th week); Month: November/2019										
Date:23- 11 2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH ₃ mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	28.3	7.6	0.03	79.2	37	6.56	25.51	40	0.4	185
2nd grab sample (4m depth)	27.3	7.6	0.03	77.6	36.4	6.83	29.92	40	0.33	182
3rd grab sample (8m depth)	26	7.6	0.03	82.3	38.7	7.14	26.79	40	0.35	180
Composite sample (1st+2nd+3rd grab sample)	26.7	7.4	0.03	79.7	37.6	7.14	26.39	40	0.38	181
Max	28.3	7.6	0.03	82.3	38.7	7.14	29.92	40	0.4	185
Min	26	7.6	0.03	77.6	36.4	6.56	25.51	40	0.33	180
Avg.	27.2	7.6	0.03	79.8	37.44	6.846	27.53	40	0.362	182.4

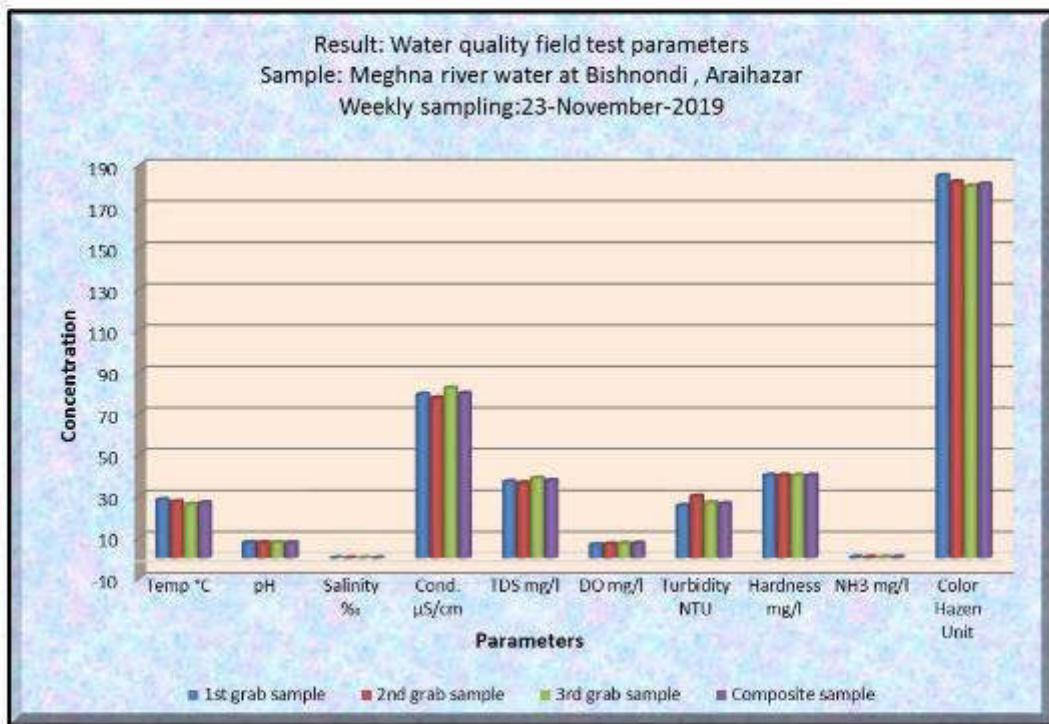


Figure A.19 Weekly sampling results; 23/11/2019



Table W-20: Weekly sampling results; Month: 30/November/2019

Water quality field test parameters (weekly sample-4 th week); Month: November/2019										
Date:30- 11-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	28.3	7.6	0.03	79.2	37	6.56	25.51	40	0.4	185
2nd grab sample (4m depth)	27.3	7.6	0.03	77.6	36.4	6.83	29.92	40	0.33	182
3rd grab sample (8m depth)	26	7.6	0.03	82.3	38.7	7.14	26.79	40	0.35	180
Composite sample (1st+2nd+3rd grab sample)	26.7	7.4	0.03	79.7	37.6	7.14	26.39	40	0.38	181
Max	28.3	7.6	0.03	82.3	38.7	7.14	29.92	40	0.4	185
Min	26	7.6	0.03	77.6	36.4	6.56	25.51	40	0.33	180
Avg.	27.2	7.6	0.03	79.8	37.44	6.846	27.53	40	0.362	182.4

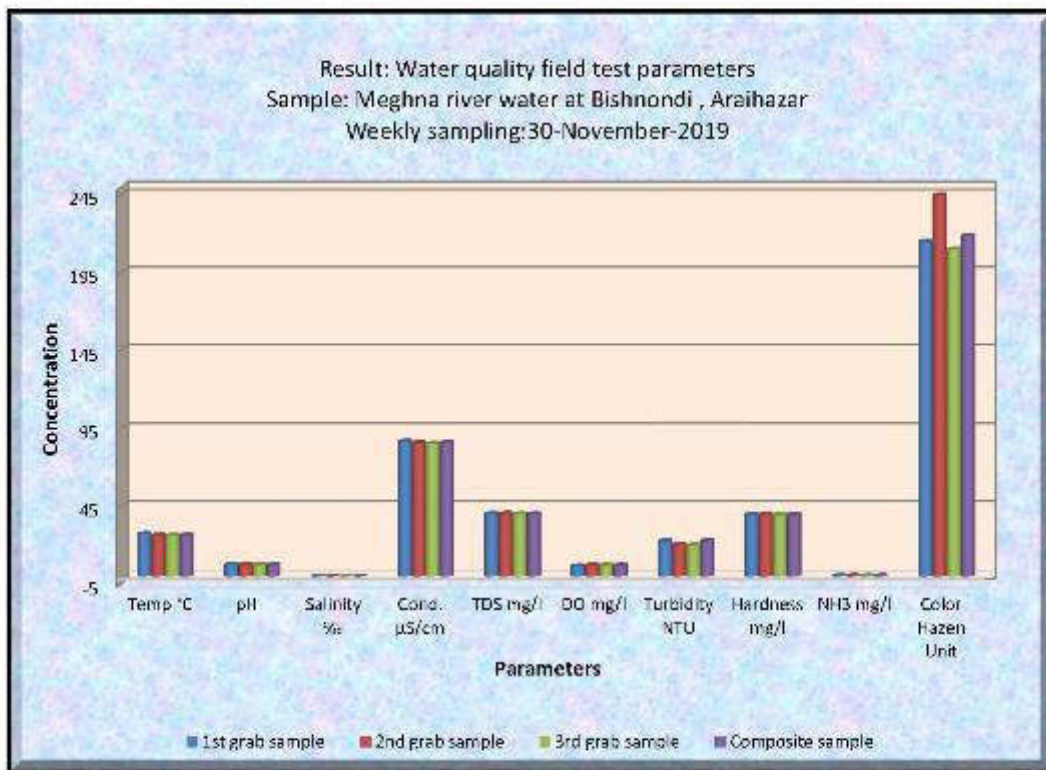


Figure A.20 Weekly sampling results; 30/11/2019



Month: December/2019

Table W-21: Weekly sampling results; Month: 07/December/2019

Water quality field test parameters (weekly sample-1 st week); Month: December/2019										
Date:07- 12-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	26.9	7.6	0.03	88.8	41.8	7.07	22.01	40	0.4	189
2nd grab sample (4m depth)	26.5	7.5	0.03	92.2	43.5	7.24	19.72	40	0.42	175
3rd grab sample (8m depth)	27.1	7.5	0.03	92.2	43.4	6.6	23.69	60	0.38	172
Composite sample (1st+2nd+3rd grab sample)	26.9	7.5	0.03	91.8	43.3	7.18	20.09	40	0.4	178
Max	26.5	7.5	0.03	88.8	41.8	6.6	19.72	40	0.38	172
Min	27.1	7.6	0.03	92.2	43.5	7.24	23.69	60	0.42	189
Avg	26.83	7.53	0.03	91.07	42.9	6.97	21.81	46.67	0.4	178.67

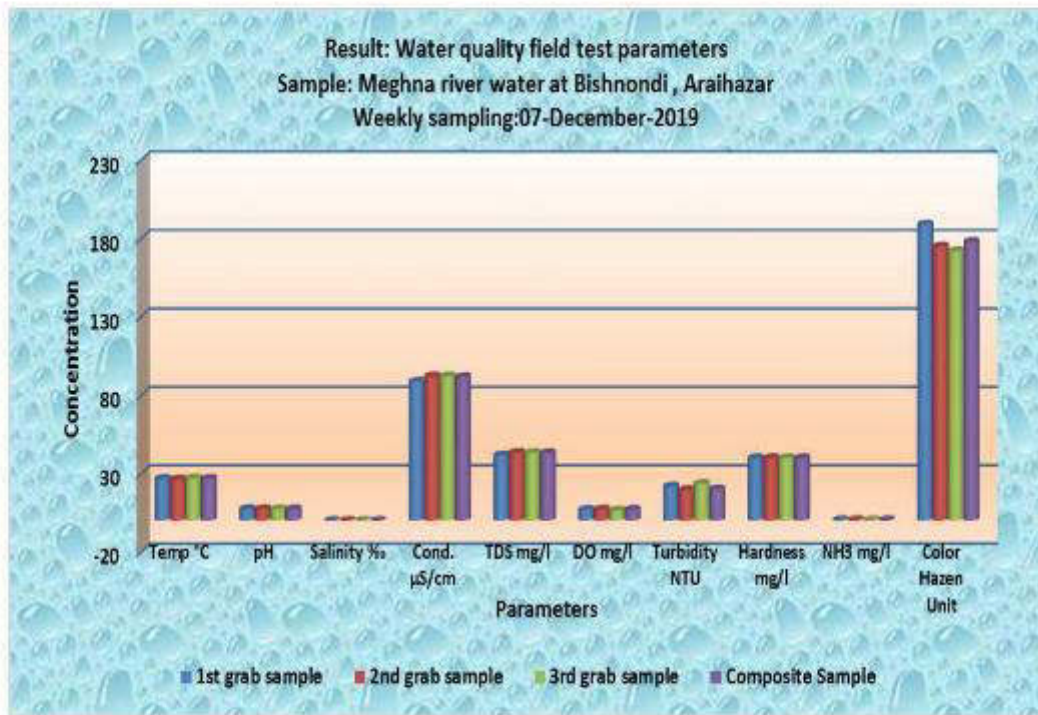


Figure A.21 Weekly sampling results; 07/12/2019



Table W-22: Weekly sampling results; Month: 14/December/2019

Water quality field test parameters (weekly sample-2 nd week); Month: December/2019										
Date:14- 12-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	26.7	7.7	0.03	91.2	43.3	7.55	20.97	40	0.48	213
2nd grab sample (4m depth)	25.9	7.6	0.03	89.7	48.1	9.42	19.87	40	0.31	197
3rd grab sample (8m depth)	25.4	7.7	0.03	89.9	43.2	8.13	22.42	40	0.47	182
Composite sample (1st+2nd+3rd grab sample)	25.8	7.6	0.03	90.4	44.7	8.42	21.77	40	0.49	189
Max	26.7	7.7	0.03	91.2	48.1	9.42	22.42	40	0.48	213
Min	25.4	7.6	0.03	89.7	43.2	7.55	19.87	40	0.31	182
Avg.	26.00	7.67	0.03	90.27	44.87	8.37	21.09	40.00	0.42	197.33

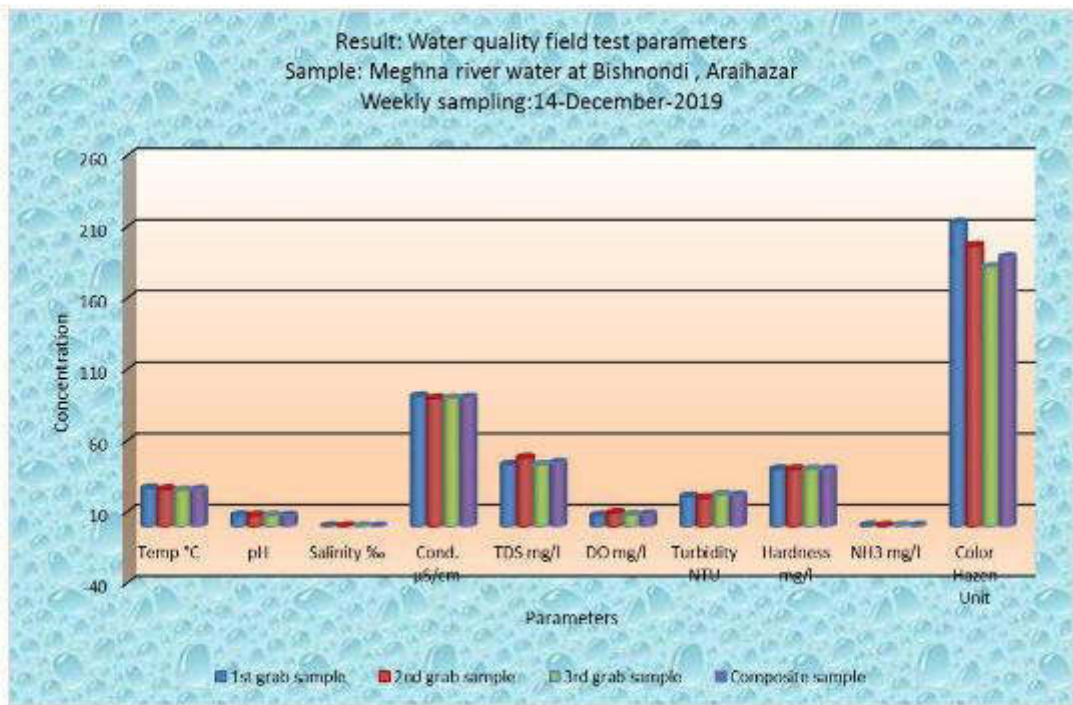


Figure A.22 Weekly sampling results; 14/12/2019



Table W-23: Weekly sampling results; Month: 21/December/2019

Water quality field test parameters (weekly sample-3 rd week); Month: November/2019										
Date:21- 12-2019						Time: 10-12				
Sample	Temp °C	pH	Salinity ‰	Cond. µS/cm	TDS mg/l	DO mg/l	Turbidity NTU	Hardness mg/l	NH3 mg/l	Color Hazen Unit
1st grab sample (0.5m depth)	20.7	7.2	0.05	104.1	48.9	7.31	16.42	60	0.52	210
2nd grab sample (4m depth)	20.5	7.2	0.05	106.5	49.6	8.16	19.66	60	0.58	192
3rd grab sample (8m depth)	20.7	7	0.05	105.5	49.2	7.94	21.83	60	0.55	201
Composite sample (1st+2nd+3rd grab sample)	20.1	7.1	0.05	104.8	49.32	7.91	19.16	60	0.56	201
Max	20.5	7	0.05	104.1	48.9	7.31	16.42	60	0.52	192
Min	20.7	7.2	0.05	106.5	49.6	8.16	21.83	60	0.58	210
Avg.	20.63	7.13	0.05	105.37	49.23	7.80	19.30	60.00	0.55	201.00

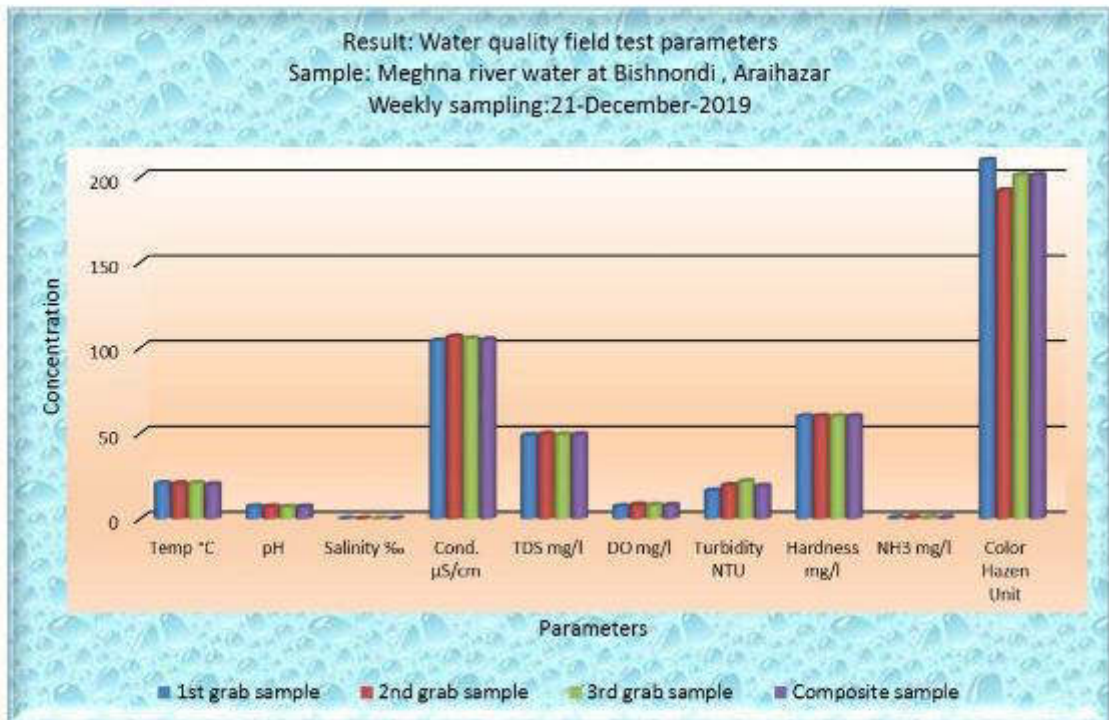


Figure A.23 Weekly sampling results; 21/12/2019